




**PRODUCT SPECIFICATIONS**

Bulletin No. 210735  
May 2017  
Supersedes April 2017




**15 and 20 Tons**  
**Net Cooling Capacity - 180,000 to 234,000 Btuh**  
**Gas Input Heat Capacity - 169,000 to 480,000 Btuh**

**MODEL NUMBER IDENTIFICATION**

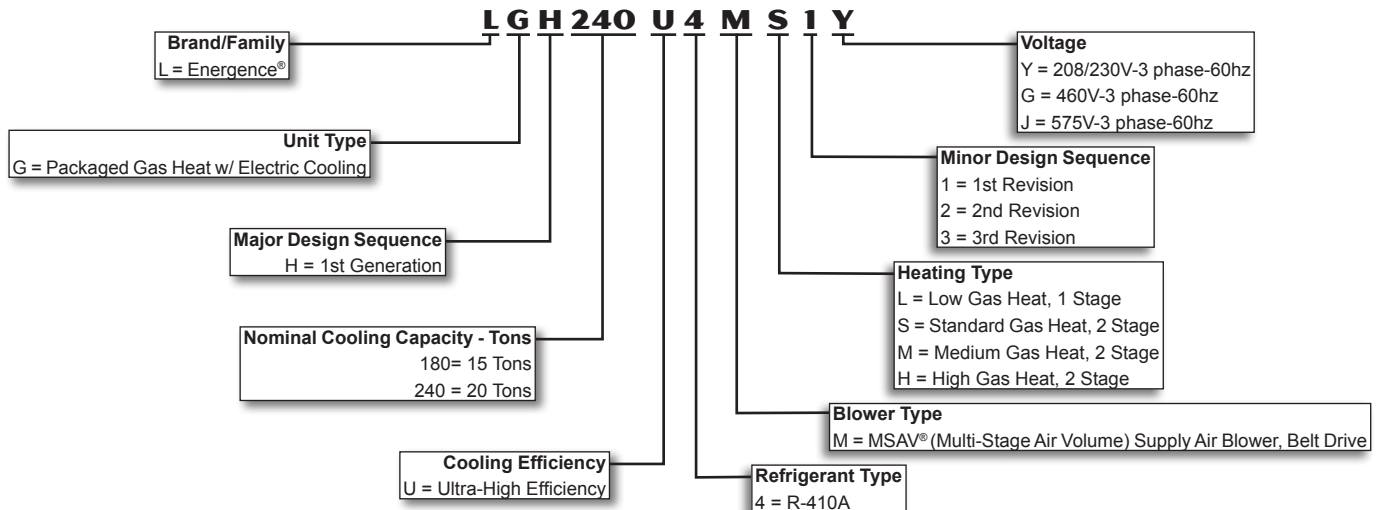

## FEATURES AND BENEFITS

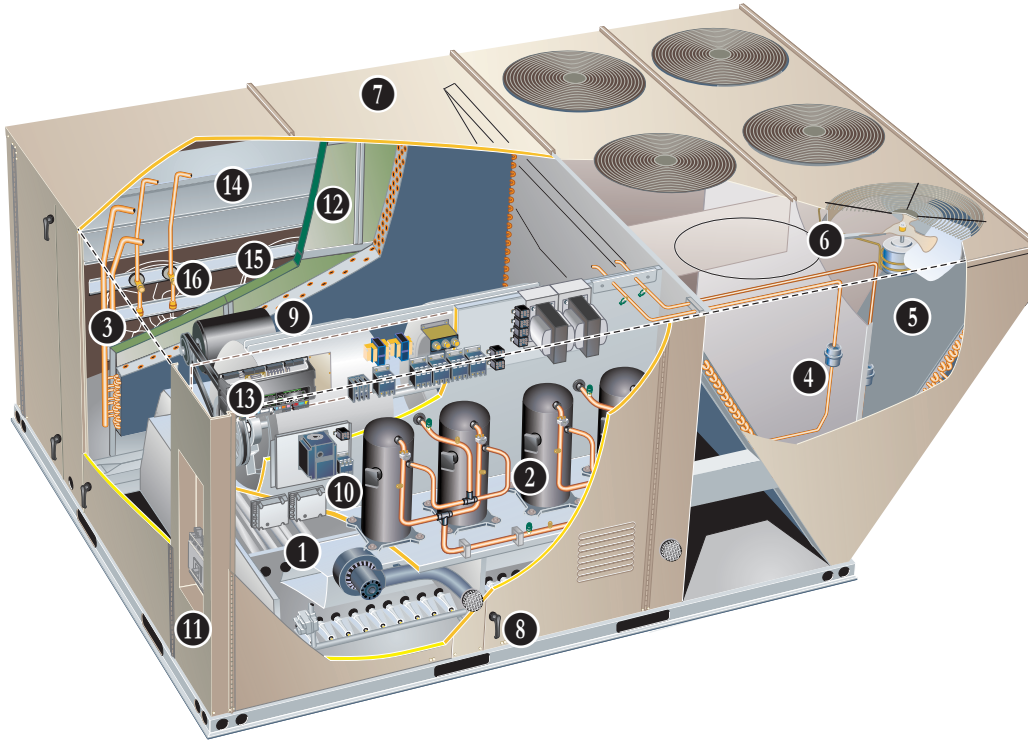

Lennox' Energence® Ultra-High Efficiency packaged rooftop unit product line was created to save energy with intelligence by offering some of the highest energy efficiency ratings available with a powerful, easy to use unit controller. This makes Energence rooftop units perfect for business owners looking for an HVAC product with the lowest total cost of ownership.

- **Hinged Access Panels** - Provide quick access to components and protect panels and roof from damage during servicing.
- **Isolated Compressor Compartment** - Allows performance check during normal compressor operation without disrupting airflow.
- **Corrosion-Resistant Removable Drain Pan** - End or bottom drain connection capability. Provides application flexibility, durability and improved serviceability.
- **Thermostatic Expansion Valves** - Provide peak cooling performance across the entire application range.
- **Ultra-High Efficiency Cooling System With Tandem Scroll Compressors** - Tandem Scroll Compressors are standard on all units for reliable, long-term operation. Advanced compressor control system operation for full or part-load conditions.
- **MSAV® (Multi-Stage Air Volume) Supply Air Blower** - Allows multi-staged air delivery.
- **Auto-Tensioner for Blower Belt** - Factory option ensures blower is delivering the proper airflow for comfort, while maximizing efficiency and belt life.
- **MERV 13 Filters** - Available as factory or field option, provide an enhanced level of indoor air quality, and can help the building qualify for additional LEED credits.
- **Foil-Faced Insulation** - Insulation on all internal surfaces that have contact with airflow helps minimize airborne fibers and improve IAQ.
- **Common Components** - Many maintenance items are standard throughout the entire product line, reducing the need to carry different parts to the job or maintain in inventory.

### Prodigy® Control System

Standard on every Energence rooftop unit, the new Prodigy® 2.0 unit controller is the heart of the Lennox® controls offering. The intuitive user interface makes setup, troubleshooting and service easier than ever. Each unit tracks the runtime of every major component and records the date and time when service or maintenance is performed.



### SmartWire™ System

The SmartWire™ system simplifies field sensor or thermostat installation through advanced connectors that are keyed and color-coded to help prevent miswiring. Not only is the wire coloring scheme standardized across all models, each connection is intuitively labeled to make troubleshooting and servicing quick and easy.

## FEATURES AND BENEFITS

### CONTENTS

Blower Data . . . . .	.28
Dimensions - Accessories . . . . .	.37
Dimensions - Unit . . . . .	.36
Electrical Accessories . . . . .	.32
Electrical Data . . . . .	.31
Features And Benefits . . . . .	2
High Altitude Derate . . . . .	.25
Model Number Identification . . . . .	1
Optional Conventional Temperature Control Systems . . . . .	.33
Options / Accessories . . . . .	.14
Outdoor Sound Data . . . . .	.32
Prodigy® Control System . . . . .	8
Ratings . . . . .	.26
Sequence Of Operation . . . . .	.17
Specifications . . . . .	.24
Specifications - Gas Heat . . . . .	.25
Sunsource® Commercial Energy System . . . . .	.11
Unit Clearances . . . . .	.32
Weight Data . . . . .	.35

### APPROVALS

AHRI Certified to AHRI Standard 340/360-2007.

ETL and CSA listed.

Efficiency ratings are certified by CSA.

Components are bonded for grounding to meet safety standards for servicing required by UL, ULC and National and Canadian Electrical Codes.

All models are ASHRAE 90.1 compliant.

All models meet California Code of Regulations, Title 24 requirements for staged airflow.

ISO 9001 Registered Manufacturing Quality System.

ENERGY STAR® certified units are designed to use less energy, help save money on utility bills, and help protect the environment.

The ENERGY STAR® Partner of the Year Award signifies that Lennox has made outstanding contributions to design energy efficient units that will lower energy bills, while meeting industry standards for comfort and indoor air quality. Lennox was the first HVAC manufacturer to win this award and has been a four-time recipient since 2003.

### WARRANTY

Limited ten years aluminized heat exchanger, limited fifteen years optional stainless steel heat exchanger.

Limited five years on compressors.

Limited three years on Prodigy® 2.0 unit controller.

Limited five years Optional High Performance Economizers.

Limited one year all other covered components.

### HEATING SYSTEM

- 1 Aluminized steel inshot burners, direct spark ignition, electronic flame sensor, combustion air inducer, redundant automatic dual stage gas valve with manual shut-off.

#### Heat Exchanger

Tubular construction, aluminized steel, life cycle tested.

Optional Stainless Steel Heat Exchanger is required if mixed air temperature is below 45°F.

#### Electronic Pilot Ignition

Electronic spark igniter provides positive direct ignition of burners on each operating cycle. The system permits main gas valve to stay open only when the burners are proven to be lit. Should a loss of flame occur, the gas valve closes, shutting off the gas to the burners. Ignition module has LED to indicate status and aid in troubleshooting.

Ignition control is factory installed in the controls section.

#### Limit Controls

Factory installed, redundant limit controls with fixed temperature setting. Heat limit controls protect heat exchanger and other components from overheating.

#### Safety Switches

Flame roll-out switch, flame sensor and combustion air inducer proving switch protect system operation.

### Required Selections

#### Gas Input Choice - Order one:

- Low Gas Heat, 1 Stage (169,000 Btuh)
- Standard Gas Heat, 2 Stage (169,000/260,000 Btuh)
- Medium Gas Heat, 2 Stage (234,000/360,000 Btuh)
- High Gas Heat, 2 Stage (312,000/480,000 Btuh)

*NOTE - Up to four stages of gas heating can be field configured on the Prodigy 2.0 unit controller. See Gas Heating Specifications table.*

## FEATURES AND BENEFITS

### **HEATING SYSTEM (continued)**

#### **Options/Accessories**

##### **Factory Installed**

**Stainless Steel Heat Exchanger**  
Required if mixed air temperature is below 45°F.

##### **Factory or Field Installed**

**Bottom Gas Piping Kit**  
Allows bottom gas entry. Field installed only, may be factory enclosed to ship with unit.

##### **Low Temperature Vestibule Heater**

Electric heater automatically controls minimum temperature in gas burner compartment when temperature is below -40°F. CSA certified to allow operation of unit down to -60°F.

##### **Field Installed**

##### **Combustion Air Intake**

###### **Extensions**

Recommended for use with existing flue extension kits in areas where high snow areas can block intake air. Order two kits.

##### **LPG/Propane Kits**

Conversion kit to field change over units from Natural Gas to LPG/Propane. Order two kits.

##### **Vertical Vent Extension Kit**

Use to exhaust flue gases vertically above unit. Required when unit vent is too close to fresh air intakes per building codes. The vent kit also prevents ice formation on intake louvers. Order two kits.

Kit contains vent transition, vent tee, drain cap and installation hardware.

*NOTE - Straight vent pipes (4 in. B-Vent) and caps are not furnished and must be field supplied. Refer to kit instructions for additional information.*

### **COOLING SYSTEM**

Designed to maximize sensible and latent cooling performance at design conditions.

System can operate from 40°F to 125°F without any additional controls.

##### **R-410A Refrigerant**

Non-chlorine based, ozone friendly, R-410A.



#### **2 Tandem Scroll Compressors**

Scroll compressors on all models for high performance, reliability and quiet operation.

Advanced cooling system design features tandem compressors arranged in two single circuit systems that operate together or independently depending on load requirements.

Compressors utilize the maximum area of the coils for maximum heat transfer.

Advanced algorithms in the Prodigy® Control System manage compressor run-times to even the load between the system when running at part-load conditions.

Compressors are resiliently mounted on rubber grommets for quiet operation.

##### **Compressor Crankcase Heaters**

Protects against refrigerant migration that can occur during low ambient operation.

#### **3 Thermal Expansion Valves**

Assures optimal performance throughout the application range. Removable element head.

#### **4 Filter/Driers**

High capacity filter/drier protects the system from dirt and moisture.

##### **High Pressure Switches**

Protects the compressors from overload conditions such as dirty condenser coils, blocked refrigerant flow, or loss of outdoor fan operation.

##### **Low Pressure Switches**

Protects the compressors from low pressure conditions such as low refrigerant charge, or low/no airflow.

##### **Freezestats**

Protects the evaporator coil from damaging ice build-up due to conditions such as low/no airflow, or low refrigerant charge.

#### **5 Condenser Coil**

Copper tube construction, enhanced rippled-edge aluminum fins, flared shoulder tubing connections, silver soldered construction.

##### **Evaporator Coil**

Copper tube construction, enhanced rippled-edge aluminum fins, flared shoulder tubing connections, silver soldered construction for improved heat transfer. Factory leak tested. Cross row circuiting with rifled tubing optimizes both sensible and latent cooling capacity.

##### **Condensate Drain Pan**

Plastic pan, sloped to meet drainage requirements per ASHRAE 62.1.

Side or bottom drain connections.

#### **6 Variable-Speed ECM Outdoor Coil Fan Motors**

Fan speed is directly controlled by the Prodigy 2.0 unit controller.

Thermal overload protected, totally enclosed, permanently lubricated ball bearings, shaft up, wire basket mount.

##### **Outdoor Coil Fans**

PVC coated fan guard furnished.

#### **Required Selections**

##### **Cooling Capacity**

Specify nominal cooling capacity of the unit



## FEATURES AND BENEFITS

### **COOLING SYSTEM (continued)**

#### **Options/Accessories**

##### **Factory or Field Installed**

##### **Condensate Drain Trap**

Field installed only, may be factory enclosed to ship with unit.

Available in copper or PVC.

##### **Drain Pan Overflow Switch**

Monitors condensate level in drain pan, shuts down unit if drain becomes clogged.

### **CABINET**

#### **7 Construction**

Heavy-gauge steel panels and full perimeter heavy-gauge galvanized steel base rail provides structural integrity for transportation, handling, and installation.

Base rails have rigging holes.

Three sides of the base rail have forklift slots.

Raised edges around duct and power entry openings in the bottom of the unit provide additional protection against water entering the building.

##### **Airflow Choice**

Units are available in downflow (vertical) or horizontal return air flow configuration.

Horizontal air flow requires Horizontal Roof Curb.

Horizontal Return Air Panel Kit is also required if converting a downflow configured unit to horizontal air flow.

##### **Power/Gas Entry**

Electrical and gas lines can be brought through the unit base or through horizontal access knock-outs

##### **Exterior Panels**

Constructed of heavy-gauge, galvanized steel with a two-layer enamel paint finish.

##### **Insulation**

All panels adjacent to conditioned air are fully insulated with non-hygroscopic fiberglass insulation.

Unit base is fully insulated. The insulation also serves as an air seal to the roof curb, eliminating the need to add a seal during installation.

#### **8 Hinged Access Panels**

Hinged tool-less access panels are provided for the filter section, the blower section and compressor/controls section.

All hinged panels have seals and quarter-turn latching handles to provide a tight air and water seal.

#### **Required Selections**

##### **Airflow Configuration**

Specify downflow or horizontal.

#### **Options/Accessories**

##### **Factory Installed**

##### **Corrosion Protection**

A completely flexible immersed coating with an electrodeposited dry film process. (AST ElectroFin E-Coat) Meets Mil Spec MIL-P-53084, ASTM B117 Standard Method Salt Spray Testing.

Indoor Corrosion Protection:

- Coated coil
- Painted blower housing
- Painted indoor base

Outdoor Corrosion Protection:

- Coated coil
- Painted outdoor base

##### **Field Installed**

##### **Combination Coil/Hail Guards**

Heavy gauge steel frame painted to match cabinet with expanded metal mesh to protect the outdoor coil from damage.

##### **Horizontal Return Air Panel Kit**

Required for horizontal applications with Horizontal Roof Curb, contains panel with return air opening for field replacement of existing unit panel and panel to cover bottom return air opening in unit, see dimension drawings.

## FEATURES AND BENEFITS

### 9 BLOWER

A wide selection of supply air blower options are available to meet a variety of airflow requirements.

#### Motor

Overload protected, equipped with ball bearings.

Belt drive motors are offered on all models and are available in several different sizes to maximize air performance.

#### Motor Efficiency

All blower motors 5 hp and above meet minimum energy efficiency standards in accordance with the Energy Independence and Security Act (EISA).of 2007.

#### Supply Air Blower

Forward curved blades, double inlet, blower wheel is statically and dynamically balanced. Equipped with ball bearings and adjustable pulley (allows speed change).

Blower assembly slides out of unit for servicing.

Grease fittings furnished.

### Required Selections

#### Select MSAV® (Multi-Stage Air Volume) Supply Air Blower

MSAV (Multi-Stage Air Volume) supply air blower will stage the amount of airflow according to compressor stages, heating demand, ventilation demand or smoke alarm.

*NOTE - Part load airflow in cooling mode should not be set below the following cfm/ton levels to reduce the risk of evaporator coil freeze-up.*

- 130 cfm/ton - 1 compressor
- 160 cfm/ton - 2 compressors
- 190 cfm/ton - 3 compressors
- 220 cfm/ton - All compressors

- 10 Utilizes a Variable Frequency Drive (VFD) to stage the supply air blower airflow. The VFD alters the frequency and voltage of the power supply to the blower to control blower speed.

The amount of airflow for each stage can be set according to a parameter in the Prodigy® 2.0 unit controller. Unit is shipped from the factory with preset airflow.

The MSAV supply air blower option can be ordered with or without an Electronic Bypass Control. If equipped with the bypass control the MSAV features manual (default) or automatic electronic bypass control of the VFD. In case of a VFD malfunction, a VFD alarm is generated by the Prodigy® 2.0 unit controller. The VFD can be manually bypassed to continue unit operation at full blower speed. Or the unit controller can be set to automatically switch to full blower speed if a VFD alarm is generated.

The VFD has an operational range of -40 to 125°F outdoor air ambient temperature.

Lower operating costs are obtained when the blower is operated on lower speeds.

#### Ordering Information

Specify motor horsepower and drive kit number when base unit is ordered.

### Options/Accessories

#### Factory Installed

##### Blower Belt Auto-Tensioner

Provides proper tension to belt drive blower belt without the need for regular adjustments. Maintains airflow and proper performance

## FEATURES AND BENEFITS

### **ELECTRICAL**

#### **SmartWire™ System**

Advanced wiring connectors are keyed and color-coded to prevent miswiring. Wire coloring scheme is standardized across all models. Each connection is intuitively labeled to make troubleshooting and servicing quick and easy.

#### **Electrical Plugs**

Positive connection electrical plugs are used to connect common accessories or maintenance parts for easy removal or installation.

#### **Phase/Voltage Detection**

Phase detection monitors power supply to assure phase is correct at unit start-up. If phase is incorrect, the unit will not start and an alarm code is reported to the unit controller. Protects unit from being started with incorrect phasing which could lead to issues such as compressors running backwards.

Voltage detection monitors power supply voltage to assure proper voltage. If voltage is not correct (over/under voltage conditions) the unit will not start and an alarm code is reported to the unit controller.

### **Required Selections**

#### **Voltage Choice**

Specify when ordering base unit.

### **Options/Accessories**

#### **Factory Installed**

##### **Circuit Breakers**

HACR type. For overload and short circuit protection. Factory wired and mounted in the power entry panel. Current sensitive and temperature activated. Manual reset.

#### **Factory or Field Installed**

##### **11 Disconnect Switch**

Accessible from outside of unit, spring loaded weatherproof cover furnished.

##### **GFI Service Outlets (2)**

115V ground fault circuit interrupter (GFCI) type, non-powered, field-wired or factory-wired and powered.

#### **Field Installed**

##### **GFI Weatherproof Cover**

Single-gang cover.

Heavy-duty UV-resistant polycarbonate case construction.

Hinged base cover with gasket.

### **INDOOR AIR QUALITY**

##### **12 Air Filters**

Disposable 2-inch filters furnished as standard.


### **Options/Accessories**

#### **Factory or Field Installed**

##### **Healthy Climate® High Efficiency Air Filters**

Disposable MERV 8 or MERV 13 (Minimum Efficiency Reporting Value based on ASHRAE 52.2) efficiency 2 inch pleated filters.

#### **Healthy Climate® UVC Germicidal Light Kit**

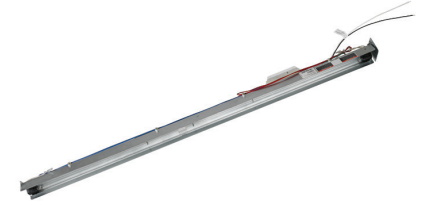

Germicidal lamps emit ultra-violet (UV-C) energy, which has been proven to be effective in reducing microbes such as viruses, bacteria, yeasts, and molds. This process either destroys the organism or controls its ability to reproduce.

UV-C energy greatly reduces the growth and proliferation of mold and other bioaerosols (bacteria and viruses) on illuminated surfaces (particularly coil and drain pan).

Lamps are field installed in the blower/evaporator coil section.

All necessary hardware for installation is included.

Lamps operate on 110/230V, 1 phase power supply. Step-down transformer must be field supplied when used with 460V and 575V rooftop units. Step-down transformer is furnished with lamps when factory installed.

Approved by ETL.

#### **Replacement Filter Media Kit With Frame**

Replaces existing pleated filter media. Includes washable metal mesh screen and metal frame with clip for holding replaceable non-pleated filter.

#### **Field Installed**

##### **Indoor Air Quality (CO<sub>2</sub>) Sensors**

Monitors CO<sub>2</sub> levels, reports to the Prodigy® Unit Controller which adjusts economizer dampers as needed.

## PRODIGY® CONTROL SYSTEM

### 13 PRODIGY 2.0 UNIT CONTROLLER



The Prodigy 2.0 unit controller is a microprocessor-based controller that provides flexible control of all unit functions.

#### Features:

**LCD Display** - Easy to read menu with buttons for menu navigation. during setup and diagnostics. 4 lines x 20 character display.

**Menu LEDs** - Four LEDs (*Data, Setup, Service, Settings*) aid in menu navigation.

**Main Menu and Help Buttons** - Quick navigation to home screen and built-in help functions.

**Scroll, Value Adjustment Select and Save Buttons**

**Simplified Setup Procedure** - SETUP menu insures proper installation and setup of the rooftop unit.

**Profile Setup** - Copy key settings between units with the same configuration greatly reducing setup time.

**USB Port** - Allows a technician to download and transfer unit information to help verify service was performed.



USB drive will also allow updating software on the Prodigy Control System to obtain enhanced functionality without the need to change components.

#### Unit Controller Software

**Unit Self-Test** - Unit Controller can perform a rooftop unit self-test to verify individual critical component and system performance. Included is an economizer test function that helps assure the economizer is operating correctly.

#### Time Clock with Run-time Information

#### Built-In Functions Include:

**Adjustable Blower On/Off Delay**

**Built-in Control Parameter Defaults**

**Compressor Time-Off Delay**

**DDC Compatible**

**Dirty Filter Switch Input**

**Discharge Air Temperature Control**

**Display/Sensor Readout**

**Economizer Control Options** - See Economizer / Outdoor Air / Exhaust Options.

**Fresh Air Tempering**

**Extensive Unit Diagnostics** - Over 100 diagnostic and status messages in English.

**Exhaust Fan Control Modes** - Fresh air damper position.

**Permanent Diagnostic Code Storage**

**Field Adjustable Control Parameters** - Over 200 different control settings.

**Indoor Air Quality Input** - Demand Control Ventilation ready

**Low Ambient Controls** - Cooling operation down to 40°F.

**Gas Valve Time Delay Between First and Second Stage**

**Minimum Compressor Run Time**

**Network Capable** - Can be daisy chained to other units or controls.

**Night Setback Mode**

**Return Air Temperature Limit Control**

**Safety Switch Input** - Allows Controller to respond to a external safety switch trip.

**Service Relay Output**

**Smoke Alarm Mode** - Four choices (unit off, positive pressure, negative pressure, purge).

**Staging** - Up to 2 heat/2 cool (standard Prodigy 2.0 unit controller thermostat input). Up to 3 cool with additional relay. Up to 4 heat/4 cool with room sensor mode.

**“Strike Three” Protection**

**Gas Reheat Control** - Simultaneous heating and cooling operation for controlling humidity for process air applications such as supermarkets.

NOTE - Prodigy Control System features shown vary with the type of rooftop unit the control is installed in.

NOTE - See separate Prodigy Control System Product Specifications Bulletin for additional information.

**Thermostat Bounce Delay**

**Warm Up Mode Delay**

**LED Indicators**

**PC Interface** - Connect to the Prodigy 2.0 unit controller from a PC with the Lennox Unit Controller Software.

**Room Sensor Operation** - Controls temperature.

#### Options / Accessories

##### Factory or Field Installed

##### **Blower Proving Switch**

Monitors blower operation, shuts down unit if blower fails.

##### **Dirty Filter Switch**

Senses static pressure increase indicating dirty filter condition.

#### Controls Options

##### Factory or Field Installed

##### **Fresh Air Tempering**

Used in applications with high outside air requirements. The Controller energizes the first stage heat as needed to maintain a minimum supply air temperature for comfort, regardless of the thermostat demand. When ordered as a factory option, the sensor ships with the unit but must be field installed.

##### **General Purpose Control Kit**

Plug-in control provides additional analog and digital inputs/outputs for field installed options.

##### **Smoke Detector**

Photoelectric type, installed in supply air section, return air section or both sections. Available with power board and single sensor (supply or return) or power board and two sensors (supply and return). Power board located in unit control compartment.

##### **Interoperability via BACnet® or LonTalk® Protocols**

Communication compatible with third-party automation systems that support the BACnet Application Specific Controller device profile, LonMark® Space Comfort Controller functional profile, or LonMark Discharge Air Controller functional profile.



## OPTIONS / ACCESSORIES

### Controls Options (continued)

#### Commercial Control Systems

##### **L Connection® Network Control System**

Complete building automation control system for single or multi-zone applications. Options include local interface, software for local or remote communication, and hardware for networking other control functions. See L Connection Network Control System Product Specifications Bulletin for details.

##### **Aftermarket DDC**

Novar® Unit ETM modules and options.

##### **Thermostats**

Control system and thermostat options. Aftermarket unit controller options.

#### Field Installed

##### **Humidity Sensor Kit**

Humidity sensor required with Supermarket reheat field selectable option.

## 14 **ECONOMIZER OPTIONS**

Economizer operation is set and controlled by the Prodigy Unit Controller.

Simple plug-in connections from economizer to unit controller for easy installation.

All Emergence rooftop units are equipped with factory installed CEC Title 24 approved sensors for outside, return and discharge air temperature monitoring.

Optional sensors may be used instead of unit sensors to determine whether outdoor air is suitable for free cooling. See Options/Accessories table.

#### Factory or Field Installed

##### **Economizer**

##### **(Standard and High Performance Common Features)**

Outdoor Air Hood with mist elimination filter is furnished.

Outdoor Air Hood is included when economizer is factory installed and is furnished with economizer when ordered for field installation.

##### **Standard Economizer Features (Not for Title 24)**

Gear-driven action, return air and outdoor air dampers, plug-in connections to unit, nylon bearings, neoprene seals, 24-volt, fully-modulating spring return motor.

*NOTE: The Free Cooling default setting for outdoor air temperature sensor is 55°F.*

##### **High Performance Economizer Features**

Approved for California Title 24 building standards.

Low leakage dampers are Air Movement and Control Association International (AMCA) Class 1A Certified - Maximum 3 CFM per sq. ft. leakage at 1 in. w.g.

ASHRAE 90.1 compliant.

Gear-driven action, high torque 24-volt fully-modulating spring return damper motor, return air and outdoor air dampers, plug-in connections to unit, stainless steel bearings, enhanced neoprene blade edge seals and flexible stainless steel jamb seals to minimize air leakage.

*NOTE - High Performance Economizers are not approved for use with enthalpy controls in Title 24 applications.*

*NOTE - The Free Cooling setpoint for Title 24 applications must be set based on the Climate Zone where the system is installed. See Section 140.4 "Prescriptive Requirements for Space Conditioning Systems" of the California Energy Commission's 2013 Building Energy Efficiency Standards.*

Refer to Installation Instructions for complete setup information and menu parameters available.

##### **Differential Sensible Control**

Factory setting. Uses outdoor air and return air sensors that are furnished with the unit. The Prodigy 2.0 unit controller compares outdoor air and return air and using setpoints, enables the economizer when the outdoor air temperature is below the configured setpoint and cooler than return air.

*NOTE - Differential Sensible Control can be configured in the field to provide Offset Differential Sensible Control or Single Sensible Control.*

*In Offset Differential Sensible Control mode, the economizer is enabled if the temperature differential (offset) between outdoor air and return air reaches the configured setpoint. In Single Sensible Control mode, the economizer is enabled when outdoor air temperature falls below the configured setpoint.*

##### **Global Control**

The unit controller communicates with a DDC system with one global sensor (enthalpy or sensible) to determine whether outside air is suitable for free cooling on all units connected to the control system. Sensor must be field provided.

*NOTE - Global control with enthalpy is not approved for Title 24 applications.*

#### Factory or Field Installed

##### **Single Enthalpy Temperature Control**

##### **(Not for Title 24)**

Outdoor air enthalpy sensor enables Economizer if the outdoor enthalpy is less than the setpoint of the control.

##### **Differential Enthalpy Control (Not for Title 24)**

Order two Single Enthalpy Controls. One is field installed in the return air section, the other in the outdoor air section. Allows the economizer control to select between outdoor air or return air, whichever has lower enthalpy..

## OPTIONS / ACCESSORIES

### **ECONOMIZER OPTIONS**

#### **(continued)**

#### **Field Installed**

##### **Outdoor Air CFM Control**

Maintains constant outdoor air volume levels on the supply air fan and varying unit airflows. Using information from a velocity sensor located in the rooftop unit outdoor air section, the Prodigy® 2.0 unit controller changes the economizer position to help minimize the effect of supply fan speed changes on outdoor air volume levels.

Setpoint for outdoor air volume is established by field testing.

*NOTE - Not available with Demand Control Ventilation (CO<sub>2</sub> Sensor) or Building Pressure Control.*

##### **Building Pressure Control**

Maintains constant building pressure level.

Using information from a differential pressure between the outdoor air and the building air, the Prodigy® 2.0 unit controller changes the economizer position to help maintain a constant building pressure.

*NOTE - Not available with Demand Control Ventilation (CO<sub>2</sub> Sensor) or Outdoor Air CFM Control.*

### **EXHAUST OPTIONS**

#### **Factory or Field Installed**

##### **Downflow Barometric Relief Dampers**

- 15 Allow relief of excess air, aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle, bird screen furnished.

Hood for downflow barometric relief dampers is factory installed when dampers are factory installed with economizer. Hood is furnished with dampers when ordered for field installation.

#### 16 **Power Exhaust Fans**

Install internal to unit for downflow applications only with economizer option. Provides exhaust air pressure relief. Interlocked to run when supply air blower is operating, fans run when outdoor air dampers are 50% open (adjustable), motor is overload protected. Requires Economizer with Outdoor Air Hood and Downflow Barometric Relief Dampers. Dual fans are 20 in. diameter with 5 blades with (2) 1/3 hp motors.

*NOTE - MSAV (Multi-Stage Air Volume) models are equipped with 2-stage power exhaust fans. Power exhaust operates in 1st stage (one fan) up to 70% of supply air blower speed. Both exhaust fans operate in 2nd stage when supply air blower speed is above 70% (adjustable) of full speed.*

#### **Field Installed**

##### **Horizontal Barometric Relief Dampers**

For use when unit is configured for horizontal applications requiring an economizer.

Allows relief of excess air. Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle.

Field installed in return air duct.

Bird screen and hood furnished.

### **OUTDOOR AIR OPTIONS**

#### **Factory or Field Installed**

##### **Outdoor Air Damper - Downflow or Horizontal With Air Hood**

Linked mechanical dampers, 0 to 25% (fixed) outdoor air adjustable, installs in unit. Includes outdoor air hood.

Automatic model features fully modulating spring return damper motor with plug-in connection.

Manual model features parallel blade, gear-driven dampers with adjustable fixed position

### **ROOF CURBS**

Nailer strip furnished, mates to unit, US National Roofing Contractors Approved, shipped knocked down.

#### **Downflow**

##### **Hybrid Roof Curbs**

Roof curb can be assembled using interlocking tabs to fasten corners together. No tools required.

Curb can also be fastened together with furnished hardware.

Available in 8, 14, 18, and 24 inch heights.

See Options/Accessories table.

##### **Adjustable Pitch Curb**

Fully adjustable pitch curbs (3/4 in. per foot in any direction) provide a level platform for rooftop units allowing flexible installations on roofs with uneven or sloped angles.

Uses interlocking tabs to fasten corners together. No tools required.

Hardware is furnished to connect upper curb with lower curb.

Available in 14 inch height.

#### **Horizontal**

Converts unit from downflow to horizontal (side) air flow, return air is on unit, supply air is on curb, see dimension drawings. Curbs for rooftop applications meet National Roofing Code requirements. Requires Horizontal Return Air Panel Kit.

Available in 26, 30, 37 and 41 inch heights.

Optional Insulation Kit is available to help prevent sweating.

##### **Adaptor Curbs (not shown)**

Curbs are regionally sourced. Dimensions will vary based upon the source. Contact your local sales representative for a detailed cut sheet with applicable dimensions.

### **CEILING DIFFUSERS**

#### **Ceiling Diffusers**


##### **(Flush or Step-Down)**

Diffuser face and grilles with white powder coat finish, insulated (UL listed duct liner), diffuser box with collars for duct connection, fixed blades (flush diffusers) and double deflection blades (step-down diffusers), provisions for suspending, internally sealed (prevents recirculation), removable return air grille, adapts to T-bar ceiling grids or plaster ceilings.

##### **Transitions (Supply and Return)**

Used with diffusers, installs in roof curb, galvanized steel construction, flanges furnished for duct connection to diffusers, fully insulated.

## SUNSOURCE® COMMERCIAL ENERGY SYSTEM

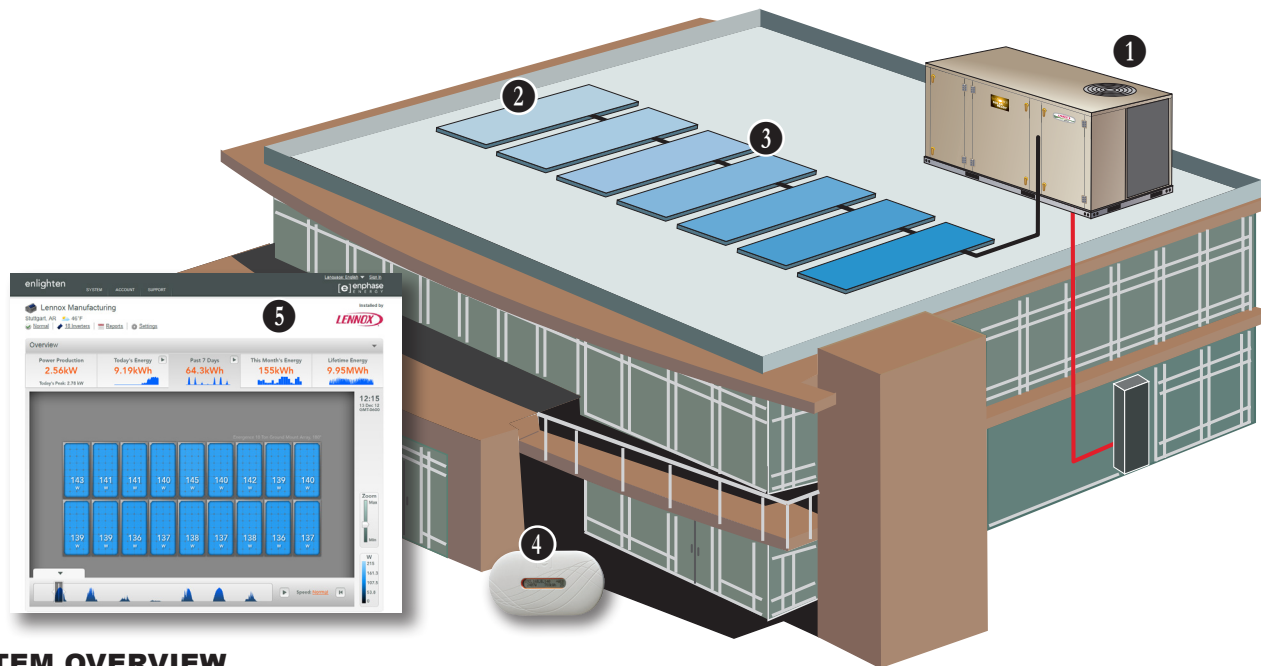

### SYSTEM OVERVIEW

All Energence® 15 and 20 ton commercial rooftop units are upgradable to the SunSource® Commercial Energy System.

Solar energy is first used to meet building cooling/heating demands. When the cooling and heating system is not operating, the system powers lighting, appliances and other electronic devices in the building. And in some locations, any surplus power is sent back to the utility company for a possible credit (check with your local utility company for availability).

The SunSource® Commercial Energy System consists of the following components:

1. Energence® 15 and 20 ton commercial rooftop units with factory installed Solar Power Entry Option (circuit protection for solar power and line voltage wiring).
2. Solarworld Solar Modules (up to 48 modules) may be used to vary the amount of electricity generated).
3. Enphase Microinverter, converts Direct Current to Alternating Current power.
4. Enphase Envoy Communications Gateway that monitors energy usage.
5. Enphase Enlighten™ Performance Monitoring Website

Wiring from the roof mounted solar modules is routed to the rooftop unit.

NOTE - Refer to separate Product Specifications Bulletin for the **SunSource® Commercial Energy System** for more detailed information. See section *Solar - Kits/Accessories*.

Also refer to **SunSource® Commercial Energy System Applications and Design Guidelines** Manual (Corp. 1303-L1) for complete information on designing, sizing and installing a complete system.

### APPROVALS

SunSource® Commercial Energy System is listed by ETL to UL 1995 and can be installed to comply with the NEC.

The SunSource® Energy System for Commercial Rooftop Units meets the requirements for federal tax credits listed under the U.S. Emergency Economic Stabilization Act of 2008, covering 30% of the cost of the solar modules, including installation.

### BASIC SYSTEM REQUIREMENTS

Sufficient south-facing open roof space.

Broadband Internet connection.

208V three-phase or 460V three-phase.

*NOTE: Transformers must be ordered for voltages other than 208V three-phase WYE.*

Grid Interconnection Agreement.

### SOLAR POWER ENTRY OPTION

A factory installed power entry option is available for Energence® rooftop units that provides a connection point for SunSource® solar modules.

The option provides circuit protection (fuses) for the solar connection and rooftop unit components.

An externally accessible disconnect (non-fused) is also included to shutdown the system for service. Field wiring connections are made directly to the disconnect for the utility connection and to pigtails for easy solar connection.


Local codes may require a field provided solar disconnect and/or a field provided fused HVAC disconnect.



## SUNSOURCE® COMMERCIAL ENERGY SYSTEM

### SOLAR MODULES

Captures solar energy to convert into AC power through the Enphase Microinverter.

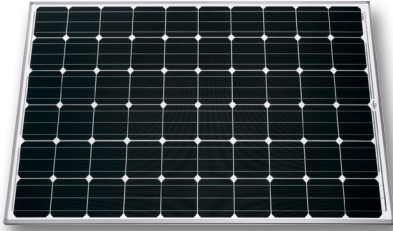

Laminated solar module structure consists of the solar glass, two ethylene vinyl acetate (EVA) sheets, the solar cell matrix and a back sheet.

Thick low-iron safety glass withstands extreme weather conditions and heavy snow loads.

Solar modules are ETL/Intertek listed for the US and Canada to UL Standard 1703 and meet National and Canadian Electrical Code requirements.

#### **Solar Module Frame**

Clear anodized aluminum frame with cast aluminum corner keys.


Low profile with extended flange.

Compatible with “top-down” and “bottom-up” mounting methods.

Eight grounding locations (Four corners of the frame and four locations along the length of the module in the extended flange).

Extended cable lengths for easier installation.

### ENPHASE MICROINVERTER

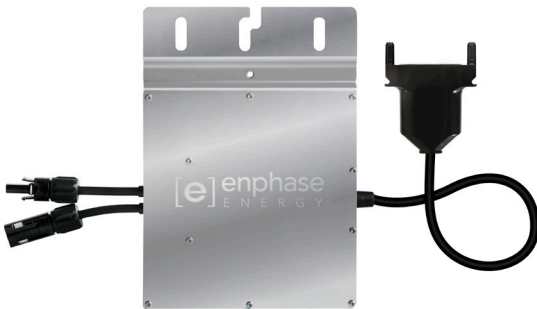

Converts Direct Current (DC), captured by a solar module, to Alternating Current (AC) power. Each solar module is paired with one Enphase Microinverter.

Installed beneath each solar module on the roof.

Enphase Microinverters operate independently from each other allowing solar modules that are not shaded or dirty to operate with optimum performance.

Supports low-light and low-voltage operation.

### FLAT ROOF MOUNTING SYSTEM

PanelClaw® Polar Bear III roof mounting system is designed to maximize array construction speed.



Innovative system consists of three major components (Support, Ballast Tray and Claw).

Modular, adaptable design with single module tilt-up feature to facilitate access to roof, wiring and maintenance.

10 degree nominal tilt angle.

Fully ballasted or mechanically attached.

- **Support** - Galvanized steel tubing. (1) Support unit with pre-installed integrated recycled rubber pads and mounting hardware.
- **Ballast Tray** - Angled fit with locking end-tab to fully capture ballast blocks. Hemmed edges and chamfered corners prevent wiring from coming into contact with sharp edges. Ballast blocks are field provided.
- **Claw** - Attachment to module using standard module mounting holes. UL 2703 certified for electric bonding and grounding. G90 galvanized steel.

### ENPHASE ENGAGE CABLE SYSTEM

- **Enphase Engage Cable** - Enphase Engage Cable (shown with connector) is a 12 AWG cable with pre-installed connectors that plug into the Enphase Microinverter.



- Five wire cable (208V three-phase)

- **Enphase Engage Cable Terminator** - Each Enphase Engage Cable is terminated at a junction or combiner box. The opposite end of the cable must be terminated with an Enphase Engage Cable Terminator cap.



- **Enphase Engage Disconnect Tool** - Specialized tool that disconnects ble from an Enphase Microinverter or watertight sealing cap.



- **Enphase Water-tight Sealing Cap** - Use when open connections on the Enphase Engage Cable are not mated to an Enphase Microinverter.



## SYSTEM MONITORING

### Enphase Envoy Communications Gateway (with Wireless Capability)

The Enphase Envoy Communications Gateway monitors Enphase Microinverter (on solar modules) performance and can be connected to a broadband internet



connection to send data to the Enphase Enlighten™ web site for online monitoring. The Enphase Envoy Communications Gateway is not required, but must be used if system performance monitoring is desired.

Limited system monitoring is also available locally with the Envoy and a personal computer if no internet connection is available.

Various Event Messages are also available when monitoring the system via a personal computer locally.

Connection options include:

- Wireless N USB adaptor (802.11b/g/n)
- Ethernet RJ45 (cable included)


NEMA 1 indoor enclosure.

Contents - (1) Envoy Communications Gateway, (1) Wireless N USB adaptor (1) 6 ft. power cord, (1) 10 ft. orange Ethernet RJ45 cable.

CSA (US/C) listed.

### Line Communications Filter

Envoy Communications Gateway mounted in a weatherproof NEMA 4 enclosure.

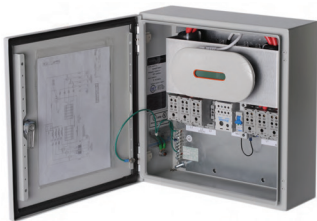


For outdoor installations, installations with transformers, or when multiple communications modules are used on one building.

Contains the Enphase Envoy Communications Gateway and terminal blocks for easy power hookup from the Enphase Microinverter branch circuits distribution to the electrical meter or distribution panel. A filter removes any electrical interference from other devices or multiple Envoy Communication Gateways in the same building.

Unit is UL listed for the US and Canada and meet National Electrical Code requirements.

### Enphase Enlighten™ Performance Monitoring Website

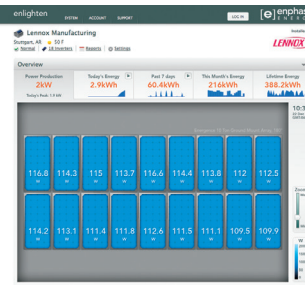

Powered by the Enphase Envoy Communications Gateway, the Enphase Enlighten™ Performance Monitoring website allows the user to keep track of building energy usage and see environmental benefits in real time.

See demos, view reference installations and other additional information at:

<http://enlighten.enphaseenergy.com/>

## SYSTEM ORDERING

- Specify the number of Solar Module CE (Custom Engineered) Kits required. The system will be shipped as a complete package.

Each kit includes:

- One Solarworld Solar Module
- One Enphase Microinverter
- One Enphase Engage Cable (no. of connectors are determined by total number of Solar Module Kits ordered)
- One PanelClaw® Polar Bear III Mounting System for the Solar Module
- Hardware for mounting
- Custom engineering drawings and full design for solar system
- Emergence® 15 and 20 ton packaged rooftop unit must be ordered with the factory installed Solar Power Entry Option.
- Enphase Envoy Communications Gateway or Line Communications Filter must be ordered separately.
- Transformers must be ordered separately. See Options/Accessories table.

Contact your nearest Lennox Sales Representative for ordering information.

## OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No.		
			180	240	
<b>COOLING SYSTEM</b>					
Condensate Drain Trap	PVC - C1TRAP20AD2	<b>76W26</b>	OX	OX	
	Copper - C1TRAP10AD2	<b>76W27</b>	OX	OX	
Corrosion Protection		Factory	O	O	
Drain Pan Overflow Switch	E1SNSR71AD1	<b>68W88</b>	OX	OX	
Refrigerant Type		R-410A	O	O	
<b>HEATING SYSTEM</b>					
Bottom Gas Piping Kit	C1GPKT01C-1	<b>85M31</b>	OX	OX	
Combustion Air Intake Extensions (order two)	LTACA1K10/15	<b>89L97</b>	X	X	
Gas Heat Input	Low - 169,000 Btuh	Factory	O		
	Standard - 260,000 Btuh	Factory	O	O	
	Medium - 360,000 Btuh	Factory	O	O	
	High - 480,000 Btuh	Factory	O	O	
Low Temperature Vestibule Heater	208/230V-3ph - C1LTVH10C-2Y	<b>13X66</b>	OX	OX	
	460V-3ph - C1LTVH10C-2G	<b>13X67</b>	OX	OX	
	575V-3ph - C1LTVH10C-2J	<b>13X68</b>	OX	OX	
LPG/Propane Conversion Kits (Order 2 kits)	Low Heat - C1PROP25C11	<b>14N28</b>	X		
	Standard Heat - C1PROP25C11	<b>14N28</b>	X	X	
	Medium Heat - C1PROP26C11	<b>14N29</b>	X	X	
	High Heat - C1PROP27C11	<b>14N30</b>	X	X	
Stainless Steel Heat Exchanger		Factory	O	O	
Vertical Vent Extension Kit (Order two kits)	C1EXTN2021	<b>42W16</b>	X	X	
<b>BLOWER - SUPPLY AIR</b>					
Blower	MSAV (Multi-Stage Air Volume) supply air blower option (With VFD Bypass Control)		Factory	O	O
	MSAV (Multi-Stage Air Volume) supply air blower option (Without VFD Bypass Control)		Factory	O	O
Motors - MSAV® Multi-Stage Air Volume	Belt Drive (standard efficiency) - 3 hp		Factory	O	
	Belt Drive (standard efficiency) - 5 hp		Factory	O	O
	Belt Drive (standard efficiency) - 7.5 hp		Factory	O	O
	Belt Drive (standard efficiency) - 10 hp		Factory		O
Drive Kits See Blower Data Tables for usage and selection	Kit #1 535-725 rpm		Factory	O	
	Kit #2 710-965 rpm		Factory	O	
	Kit #3 685-856 rpm		Factory	O	O
	Kit #4 850-1045 rpm		Factory	O	O
	Kit #5 945-1185 rpm		Factory	O	O
	Kit #6 850-1045 rpm		Factory	O	O
	Kit #7 945-1185 rpm		Factory	O	O
	Kit #8 1045-1285 rpm		Factory	O	O
	Kit #10 1045-1285 rpm		Factory		O
	Kit #11 1135-1365 rpm		Factory		O
	Blower Belt Auto-Tensioner		Factory	O	O

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No.	
			180	240
<b>CONTROLS</b>				
Blower Proving Switch	C1SNSR35FF1	<b>53W65</b>	OX	OX
Commercial Controls	L Connection® Building Automation System	- - -	X	X
	Prodigy® Control System - BACnet® Module - C0CTRL60AE1L	<b>59W51</b>	OX	OX
	Prodigy® Control System - LonTalk® Module - C0CTRL65FF1	<b>54W27</b>	OX	OX
	Novar® ETM-2051 - E0CTRLO30C1	<b>64W74</b>	OX	OX
	Novar® LSE	Factory	O	O
Dirty Filter Switch	E1SNSR55C-1	<b>53W68</b>	OX	OX
Fresh Air Tempering	C1SNSR75AD1	<b>58W63</b>	OX	OX
General Purpose Control Kit	E1GPBK30C1	<b>13J78</b>	X	X
Smoke Detector - Supply or Return (Power board and one sensor)	C1SNSR44C-1	<b>83W40</b>	OX	OX
Smoke Detector - Supply and Return (Power board and two sensors)	C1SNSR43C-1	<b>83W41</b>	OX	OX
<b>INDOOR AIR QUALITY</b>				
<b>Air Filters</b>				
Healthy Climate® High Efficiency Air Filters	MERV 8 - C1FLTR15C-1-	<b>54W67</b>	OX	OX
24 x 24 x 2 (Order 6 per unit)	MERV 13 - C1FLTR40C-1-	<b>52W40</b>	OX	OX
Replacement Media Filter With Metal Mesh Frame (includes non-pleated filter media)	C1FLTR30C-1-	<b>44N61</b>	OX	OX
<b>Indoor Air Quality (CO<sub>2</sub>) Sensors</b>				
Sensor - Wall-mount, off-white plastic cover with LCD display	C0SNSR50AE1L	<b>77N39</b>	X	X
Sensor - Wall-mount, off-white plastic cover, no display	C0SNSR52AE1L	<b>87N53</b>	X	X
Sensor - Black plastic case with LCD display, rated for plenum mounting	C0SNSR51AE1L	<b>87N52</b>	X	X
Sensor - Wall-mount, black plastic case, no display, rated for plenum mounting	C0MISC19AE1	<b>87N54</b>	X	X
CO <sub>2</sub> Sensor Duct Mounting Kit - for downflow applications	C0MISC19AE1-	<b>85L43</b>	X	X
Aspiration Box - for duct mounting non-plenum rated CO <sub>2</sub> sensors (87N53 or 77N39)	C0MISC16AE1-	<b>90N43</b>	X	X
<b>UVC Germicidal Light Kit</b>				
<sup>1</sup> Healthy Climate® UVC Light Kit (110/230v-1ph)		<b>54W65</b>	OX	OX
<b>ELECTRICAL</b>				
Voltage 60 hz	208/230V - 3 phase	Factory	O	O
	460V - 3 phase	Factory	O	O
	575V - 3 phase	Factory	O	O
HACR Circuit Breakers		Factory	O	O
Disconnect Switch	80 amp - E1DISC080C-1	<b>54W88</b>	OX	OX
(see Disconnect Table for usage, page 33)	150 amp - E1DISC150C-1	<b>54W89</b>	OX	OX
GFI Service	15 amp non-powered, field-wired (208/230V, 460V, 575V) LTAGFIK10/15	<b>74M70</b>	OX	OX
Outlets	15 amp factory-wired and powered (208/230V, 460V, 575V)	Factory	O	O
	20 amp non-powered, field-wired (575V only) C1GFIC120FF1	<b>67E01</b>	OX	OX
Weatherproof Cover for GFI	C1GFIC199FF1	<b>10C89</b>	X	X
<b>ECONOMIZER</b>				
<b>Standard Economizer (Not for Title 24)</b>				
Standard Economizer	E1ECON15C-2	<b>13U47</b>	OX	OX
Downflow or Horizontal Applications - Includes Outdoor Air Hood. Order Downflow or Horizontal Barometric Relief Dampers separately.				
<b>High Performance Economizer (Approved for California Title 24 Building Standards / AMCA Class 1A Certified)</b>				
High Performance Economizer	E1ECON17C-1	<b>10U60</b>	OX	OX
Downflow or Horizontal Applications - Includes Outdoor Air Hood. Order Downflow or Horizontal Barometric Relief Dampers separately.				
<b>Economizer Controls</b>				
Differential Enthalpy (Not for Title 24)	Order 2 - C1SNSR64FF1	<b>53W64</b>	OX	OX
Sensible Control	Sensor is Furnished	Factory	O	O
Single Enthalpy (Not for Title 24)	C1SNSR64FF1	<b>53W64</b>	OX	OX
Global Control	Sensor Field Provided	Factory	O	O
Building Pressure Control	E1GPBK20C1	<b>13J77</b>	X	X
Outdoor Air CFM Control	E1GPBK10C1	<b>13J76</b>	X	X
<b>Barometric Relief Dampers With Exhaust Hood</b>				
Downflow Barometric Relief Dampers	C1DAMP50C	<b>54W78</b>	OX	OX
Horizontal Barometric Relief Dampers	LAGEDH18/24	<b>16K99</b>	X	X

<sup>1</sup> Lamps operate on 110-230V single-phase power supply. Step-down transformer must be field supplied for field installation in 460V and 575V rooftop units (transformer is furnished for factory installed light kits). Alternately, a separate 110V power supply may be used to directly power the UVC ballast(s).

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed



## OPTIONS / ACCESSORIES

Item Description	Model Number	Catalog Number	Unit Model No.	
			180	240
<b>OUTDOOR AIR</b>				
<b>Outdoor Air Dampers With Outdoor Air Hood</b>				
Motorized	C1DAMP20C-1	13U04	OX	OX
Manual	C1DAMP10C-2	13U05	OX	OX
<b>POWER EXHAUST</b>				
Standard Static	208/230V - C1PWRE11C-1Y	75W90	OX	OX
	460V - C1PWRE11C-1G	75W91	OX	OX
	575V - C1PWRE11C-1J	75W92	OX	OX
<b>CABINET</b>				
Combination Coil/Hail Guards	C1GARD51C21	13T12	X	X
<b>ROOF CURBS</b>				
<b>Hybrid Roof Curbs, Downflow</b>				
8 in. height	C1CURB70C-1	11F58	X	X
14 in. height	C1CURB71C-1	11F59	X	X
18 in. height	C1CURB72C-1	11F60	X	X
24 in. height	C1CURB73C-1	11F61	X	X
<b>Adjustable Pitch Curb</b>				
14 in. height	L1CURB55C	43W26	X	X
<b>Standard Roof Curbs, Horizontal - Requires Horizontal Return Air Panel Kit</b>				
26 in. height - slab applications	C1CURB14C-1	11T89	X	X
37 in. height - rooftop applications	C1CURB16C-1	11T96	X	X
<b>Insulation Kit For Standard Horizontal Roof Curbs</b>				
for C1CURB14C-1	C1INSU11C-1-	73K32	X	X
for C1CURB16C-1	C1INSU13C-1-	73K34	X	X
<b>Horizontal Return Air Panel Kit</b>				
Required for Horizontal Applications with Roof Curb	C1HRAP10C-1-	87M00	X	X
<b>CEILING DIFFUSERS</b>				
Step-Down - Order one	RTD11-185S	13K63	X	
	RTD11-275S	13K64		X
Flush - Order one	FD11-185S	13K58	X	
	FD11-275S	13K59		X
Transitions (Supply and Return) - Order one	C1DIFF33C-1	12X68	X	
	C1DIFF34C-1	12X70		X
<b>SUNSOURCE® COMMERCIAL ENERGY SYSTEM</b>				
Solar Module CE Kit	One 285W Solar Module (silver frame), One PanelClaw Polar Bear III Mounting System and One Enphase M250 Microinverter	10U67	X	X
Solar Power Entry with Disconnect		Factory	O	O
Enphase Envoy Communications Gateway (with Wireless Capability)		13L89	X	X
Line Communication Filter (external)		10F93	X	X
<sup>1</sup> Transformer (6 kW)	E1TRFM15AD3Y (208Y to 208 VAC Delta)	11H71	X	X
	E1TRFM15AD2Y (230 VAC Delta)	11H28	X	X
	E1TRFM15AD3G (460 VAC Delta or Wye)	11H29	X	X

<sup>1</sup> Order one 6 kW transformer per array (up to 24 solar modules each). Up to two arrays can be used per rooftop unit (total 48 modules). Arrays are field wired in parallel to the Solar Power Entry

NOTE - Catalog and model numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## **SEQUENCE OF OPERATION**

### **HEATING MODE**

**NOTE - Heating Mode can be set to 2 stage in thermostat mode or at 4 stage in room sensor mode control options.**

#### **2 STAGE OPERATION:**

##### **W1 Demand:**

Both gas valves are open on Low Fire (stage 1 on units with 2-stage gas valves) and supply air blower operates at heating speed.

##### **W2 Demand:**

Both gas valves are open on High Fire (stage 2 on units with 2-stage gas valves) and supply air blower operates at heating speed.

#### **4 STAGE OPERATION:**

##### **W1 Demand:**

Left heat exchanger gas valve is open on Low Fire (stage 1 on units with 4-stage gas valves) and supply air blower operates at heating speed.

##### **W2 Demand:**

Both gas valves are open on Low Fire (stage 2 on units with 4-stage gas valves) and supply air blower operates at heating speed.

##### **W3 Demand:**

Left heat exchanger gas valve will open on High Fire and the right heat exchanger will remain open on Low Fire (stage 3 on units with 4-stage gas valves) and supply air blower operates at heating speed.

##### **W4 Demand:**

Both gas valves are open on High Fire (stage 4 on units with 4-stage gas valves) and supply air blower operates at heating speed.

### **MODULATING OUTDOOR AIR DAMPER**

The minimum damper position for “occupied low blower” and “occupied high blower” is adjusted during unit setup to provide minimum fresh air requirements per ASHRAE 62.1 at the corresponding supply air blower speeds.

When supply air blower is off or the unit is in unoccupied mode, the outdoor air damper is closed.

When unit is in occupied mode and supply air blower is operating at a speed below the “midpoint” blower speed, the outdoor air damper is at minimum “low blower” position.

When unit is in occupied mode and supply air blower is operating at a speed equal to or above the “midpoint” blower speed, the outdoor air damper is at minimum “high blower” position.

**NOTE - The “midpoint” blower speed is an average of the minimum and maximum blower speed (minimum speed + maximum speed divided by 2).**

### **THERMOSTAT MODE**

The thermostat mode has specific sequence-of-operation scenarios for Lennox' Emergence® Ultra-High Efficiency product line. The standard thermostat mode will typically allow 2 stages of heating and cooling operation. Units with a globally-controlled economizer option can have 2 stages of mechanical cooling and free cooling economizer operation. The MSAV® (Multi-Stage Air Volume) blower will also allow up to 5 different supply blower CFM values: 2 CFM values for cooling mode, 1 CFM value for heating mode, 1 CFM value for ventilation, and an extra speed for when one of the smoke alarm options is used. When using the factory default, the smoke alarm mode will turn off the blower. It is important to note that the unit controller merely passes along the instructions to provide heating, cooling, or other unit operations.

## SEQUENCE OF OPERATION

### **THERMOSTAT MODE - MSAV® (MULTI-STAGE AIR VOLUME) (CONTINUED)**

#### **OPERATION WITH 2-STAGE THERMOSTAT**

##### **Supply Air Blower CFM**

Unit has the following supply air blower CFM settings:

- Heating CFM
- High Cooling CFM
- Low Cooling CFM
- Ventilation CFM
- Blower Speed
- Smoke Speed (Used only in smoke removal option - not covered here)

---

##### **Unit Features An Economizer And Outdoor Air Is Suitable**

*NOTE - Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third-party controller and provided to the rooftop unit via a network connection.*

##### **Y1 Demand:**

All compressors are off, supply air blower is on low cooling CFM to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain Parameter 159 setting (supply air temperature).

##### **Y2 Demand:**

All compressors are off, supply air blower is on high cooling CFM providing higher cooling capacity, and economizer modulates to maintain Parameter 159 setting (supply air temperature).

Parameter 164 dictates when one compressor from each circuit is energized while supply air blower stays on high cooling CFM providing maximum cooling capacity. After compressor is energized the economizer stays at maximum open.

##### **Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable**

##### **Y1 Demand:**

One compressor from each circuit operates and supply air blower operates at low cooling CFM.

##### **Y2 Demand:**

All compressors operate and supply air blower operates at high cooling CFM.

---

## SEQUENCE OF OPERATION

### **THERMOSTAT MODE - MSAV® (MULTI-STAGE AIR VOLUME) (CONTINUED)**

#### **OPERATION WITH 3-STAGE THERMOSTAT**

##### **Supply Air Blower CFM**

Unit has following supply air blower CFM settings:

- Heating CFM
  - High Cooling CFM
  - Medium-Low Cooling CFM
  - Low Cooling CFM
  - Ventilation CFM
  - Blower Speed
  - Smoke Speed (Used only in smoke removal option - not covered here)
- 

##### **Unit Features An Economizer And Outdoor Air Is Suitable**

*NOTE - Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third-party controller and provided to the rooftop unit via a network connection.*

##### **Y1 Demand:**

All compressors are off, supply air blower is on low cooling CFM to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain Parameter 159 setting (supply air temperature).

##### **Y2 Demand:**

All compressors are off, supply air blower is on high cooling CFM providing higher cooling capacity, economizer modulates (minimum to maximum open position) to maintain Parameter 159 setting (supply air temperature).

Parameter 164 dictates when one compressor from each circuit is energized while supply air blower stays on high cooling CFM providing maximum cooling capacity. After compressors are energized the economizer stays at maximum open.

##### **Y3 Demand:**

All compressors are energized and supply air blower stays on high cooling CFM.

##### **Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable**

##### **Y1 Demand:**

One compressor operates and supply air blower operates at low cooling CFM.

##### **Y2 Demand:**

One compressor from each circuit operates and supply air blower operates at medium-low cooling CFM.

##### **Y3 Demand:**

All compressors from each circuit operate and supply air blower operates at high cooling CFM.

---



## SEQUENCE OF OPERATION

### **ZONE SENSOR MODE**

When in zone sensor mode, the unit can modulate four stages of cooling or two stages of heating operation. In this case, the unit controller will control all unit staging operations. While in zone sensor mode, multi-stage air volume applications can use up to 4 different supply blower CFM values for cooling. Zone sensor mode takes full advantage of the unit controller's features, increasing staging and control capabilities. To operate correctly, the unit must receive information from a temperature sensor. It may also receive setpoint information from a network device. Based on this information, the unit controller will either turn on or off various cooling and heating stages to maintain comfort control.

In zone sensor mode, it is possible to operate the unit without a network device. In this case the unit controller will control the zone temperature based on the backup occupied and unoccupied setpoints stored in the unit controller. The unit controller decides which setpoints to use based on the status of the occupied input. For example, if the unit is in occupied mode, the unit controller will use the occupied backup setpoints and if the unit is not in unoccupied mode the unit controller will use the unoccupied backup setpoints. In this scenario the unit controller not only records diagnostic information and makes sure the unit maintains safe operation limits,. It also controls all staging and unit operations.

### **ZONE SENSOR MODE HEATING**

For heating, the unit controller monitors space temperature from the zone sensor. Based on this information and the setpoints sent to the unit controller from the Lennox or third-party network device, the unit controller turns on or off the heating stages to maintain the desired temperature setpoint.

The LGH Ultra-High Efficiency product line features up to four independent heat stages in larger equipment. The exact percent of heating capacity used will vary depending on the size of the unit and the heating capacity. Regardless of how many stages are present, the unit controller will seek to provide the right amount of heat to satisfy the demand.

The sequence of operation for increasing and decreasing heating stages is best shown by the staging chart on page 26. As you can see from the chart, the unit will activate the heating stages if the space temperature drops to certain temperatures. If the temperature continues to drop, the unit will continue to add heating stages until the unit reaches full heating capacity. Notice that the example heating setpoint is 70°F with a 1° deadband. Also notice that the stage-up timer is 15 minutes. The unit controller will call for the next heating stage if the space temperature has been in the stage-up timer deadband region for 15 continuous minutes. The stage-up timer deadband region is the range between the temperature at which the current heating stage was called, and the temperature at which the next heating stage would be called. Heating stages will deactivate immediately after the space temperature has been satisfied. These are all default setpoints and can be changed to customize the unit to the specific application.

It is important to note that units with multi-stage air volume supply blowers operate at the selected heating speed for all stages of heating. The supply blower speed will not change as heat stages increase or decrease because there is only one heating supply blower speed setpoint.

### **ZONE SENSOR MODE COOLING**

For cooling, the unit controller monitors space temperature from the zone sensor. Based on this information and the setpoints sent to the unit controller from an optional Lennox or third-party network device, the unit controller turns on or off cooling stages to maintain the desired temperature setpoint.

The LGH Ultra-High Efficiency product line features up to four independent cooling stages in larger equipment. Regardless of how many stages are available, the unit controller will seek to provide the right amount of cooling to satisfy the demand. This helps provide great comfort control and to minimize energy consumption. The sequence of operation for increasing and decreasing cooling stages is best shown by the staging chart on page 26. As you can see from the chart, the unit will activate cooling stages if the space temperature rises above certain setpoints. If the temperature continues to rise, the unit will continue to add cooling stages until the unit reaches full cooling capacity. Notice that the example cooling setpoint is 75°F with a 1° deadband. Notice that the stage-up timer is 15 minutes. The unit controller will call for the next cooling stage if the space temperature has been in the stage-up timer deadband region for 15 continuous minutes. The stage-up timer deadband region is the range between the temperature at which the current cooling stage was called, and the temperature at which the next cooling stage would be called. Cooling mode has a stage-down delay default that keeps the next lower stage on for 15 minutes after a higher stage has ended. This feature is to make sure the unit doesn't prematurely shut off a cooling stage. These are all default setpoints and can be changed to customize the unit to the specific application.

## SEQUENCE OF OPERATION

### ZONE SENSOR MODE (continued)

#### ZONE SENSOR MODE COOLING WITH/WITHOUT ECONOMIZER

If the outdoor air is suitable and the unit features an economizer, instead of using mechanical cooling to meet the first cooling demand, the unit controller will try to meet the demand by opening the economizer and using outdoor air. The economizer damper will modulate to maintain Parameter 159 setting (supply air temperature) to meet the cooling demand.

If mechanical cooling is locked out because of low ambient outside air temperature, then mechanical cooling will not come on and the unit will attempt to satisfy any demand by modulating the economizer's damper position to maintain Parameter 159 setting (supply air temperature). The setpoints at which mechanical cooling locks out and the economizer maintains supply air temperature are adjustable.

If mechanical cooling is not locked out and if the unit is able to satisfy the room temperature requirements using outdoor air, then the unit will close the economizer to the minimum setpoint and cease cooling operation. If the unit is unable to satisfy the room temperature requirements using outdoor air, then the unit will react to a second cooling demand, which will trigger the first stage of mechanical cooling and bring the economizer to the full open position. The unit will continue turning on stages of mechanical cooling until the unit has satisfied the space temperature setpoint. Because the unit can provide up to 4 stages of cooling, and the economizer now qualifies as the first stage of cooling, the unit controller will group the remaining two compressors in a four compressor unit together in the event that two compressors are already energized. This means that to address the fourth stage cooling demand the unit will increase the mechanical cooling from two compressors energized to all compressors energized.

See table for unit operation without an economizer.

#### ZONE SENSOR MODE COOLING

Cooling Demand	Unit with Economizer	Unit Without Economizer or Outdoor Air is Unsuitable
One	Economizer	One Compressor
Two	Economizer + One Compressor	Two Compressors
Three	Economizer + Two Compressors	Three Compressors
Four	Economizer + All Compressors	All Compressors

# SEQUENCE OF OPERATION


## ZONE SENSOR MODE (continued)

### ROOM SENSOR STAGES FOR GAS / ELECTRIC UNITS Default Values Shown

Units With Economizer:  
 C1=Free Cooling  
 C2=Compressor 1  
 C3=Compressor 2  
 C4=Compressor 3 + 4

C1=Cooling Stage 1  
 C2=Cooling Stage 2  
 C3=Cooling Stage 3  
 C4=Cooling Stage 4

H1=Heating Stage 1  
 H2=Heating Stage 2  
 H3=Heating Stage 3  
 H4=Heating Stage 4

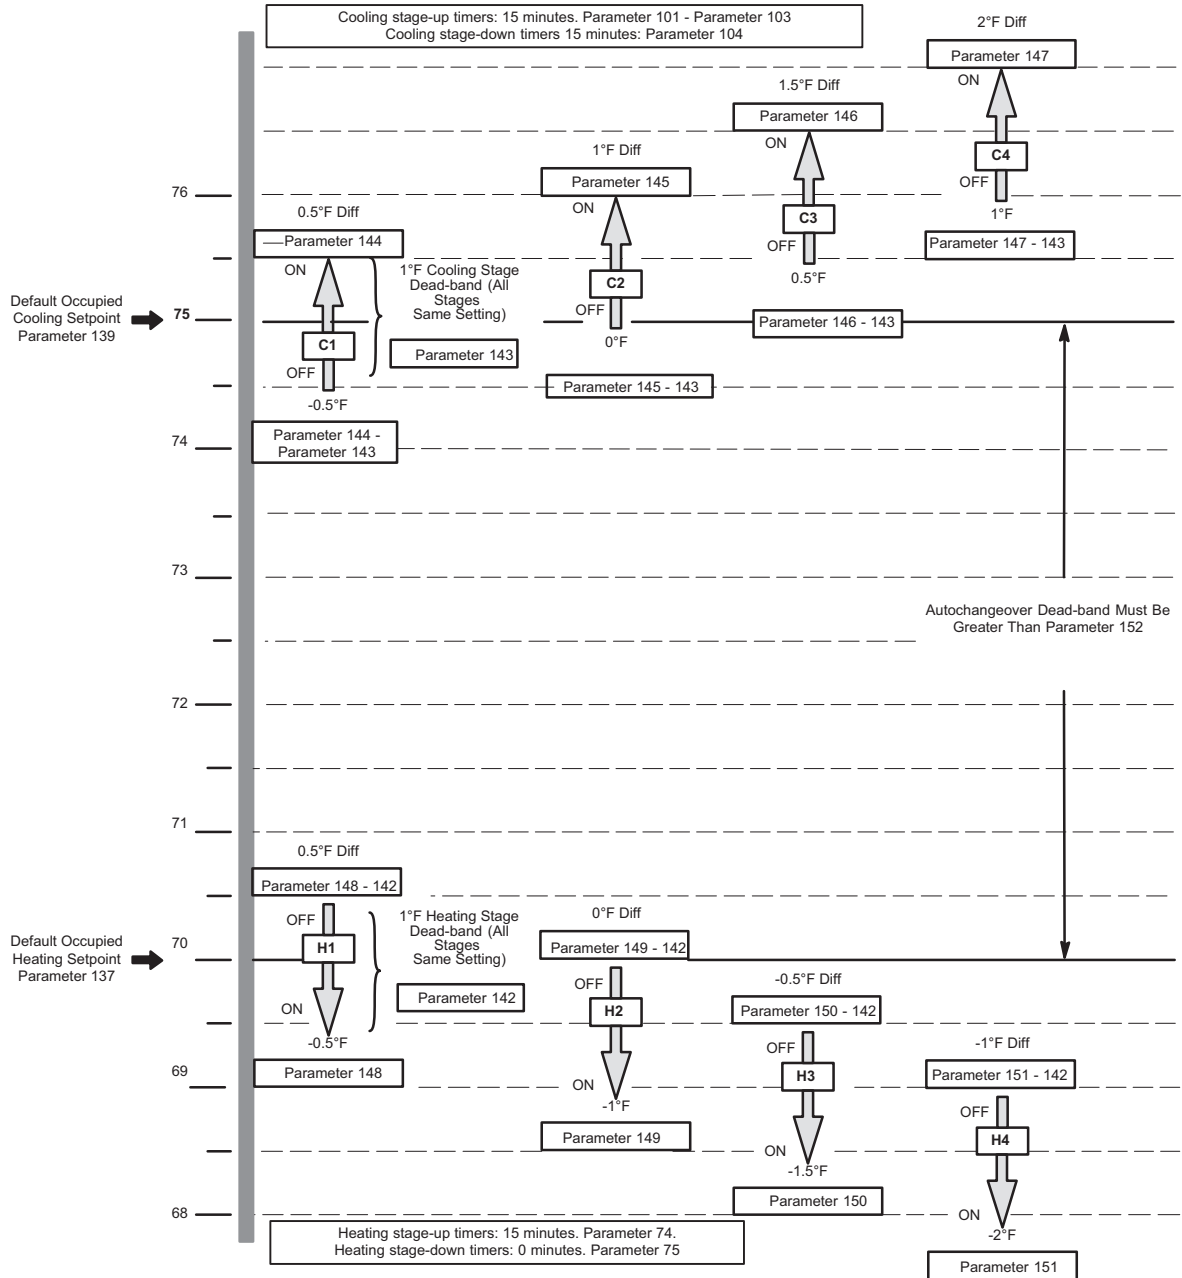

## SEQUENCE OF OPERATION

### **ZONE SENSOR MODE - MSAV® (MULTI-STAGE AIR VOLUME) (CONTINUED)**

#### **Supply Air Blower CFM**

Unit has following supply air blower CFM settings:

- Heating CFM
- High Cooling CFM
- Medium-High Cooling CFM
- Medium-Low Cooling CFM
- Low Cooling CFM
- Ventilation CFM
- Blower Speed
- Smoke Speed (Used only in smoke removal option - not covered here)

---

#### **Unit Features An Economizer And Outdoor Air Is Suitable**

*NOTE - Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third-party controller and provided to the rooftop unit via a network connection.*

#### **Y1 Demand:**

All compressors are off, supply air blower is on low cooling CFM to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain Parameter 159 setting (supply air temperature).

#### **Y2 Demand:**

All compressors are off, supply air blower is on high cooling CFM providing higher cooling capacity, and economizer modulates to maintain Parameter 159 setting (supply air temperature).

Parameter 164 dictates when one compressor is energized while supply air blower stays on high cooling CFM providing maximum cooling capacity. After compressors are energized the economizer stays at maximum open.

#### **Y3 Demand:**

Two compressors are energized while supply air blower is on high cooling CFM providing even higher cooling capacity.

#### **Y4 Demand:**

All compressors are energized while supply air blower is on high cooling CFM providing maximum cooling capacity.

#### **Unit Does Not Feature An Economizer (Or Outdoor Air Is Not Suitable)**

#### **Y1 Demand:**

One compressor operates and supply air blower operates at low cooling CFM.

#### **Y2 Demand:**

Two compressors operate and supply air blower operates at medium-low cooling CFM.

#### **Y3 Demand:**

Three compressors operate and supply air blower operates at medium-high cooling CFM.

#### **Y4 Demand:**

All compressors operate and supply air blower operates at high cooling CFM.

## SPECIFICATIONS

General Data		Nominal Tonnage	15 Ton	20 Ton
		<b>Model Number</b>	<b>LGH180U4M</b>	<b>LGH240U4M</b>
		<b>Efficiency Type</b>	<b>Ultra</b>	<b>Ultra</b>
		<b>Blower Type</b>	MSAV (Multi-Stage Air Volume)	MSAV (Multi-Stage Air Volume)
<b>Cooling Performance</b>	Gross Cooling Capacity - Btuh		185,300	241,000
	<sup>1</sup> Net Cooling Capacity - Btuh		180,000	234,000
	AHRI Rated Air Flow - cfm		5,200	6400
	Total Unit Power - kW		14.2	19.5
	<sup>1</sup> EER (Btuh/Watt)		12.7	12.0
	<sup>2</sup> IEER (Btuh/Watt)		20.2	20.0
	Refrigerant Type		R-410A	R-410A
<b>Refrigerant Charge</b>	Circuit 1		20 lbs. 0 oz.	21 lbs. 4 oz.
	Circuit 2		20 lbs. 8 oz.	22 lbs. 0 oz.
<b>Gas Heating Options Available</b>		See page 26		
<b>Compressor Type (number)</b>			Tandem Scroll (4)	Tandem Scroll (4)
<b>Outdoor Coils</b>	Net face area (total) - sq. ft.		55.2	55.2
	Tube Diameter - in.		3/8	3/8
	Number of rows		2	2
	Fins per inch		20	20
<b>Outdoor Coil Fans</b>	Motor - (No.) horsepower		(6) 1/3 ECM	(6) 1/3 ECM
	Motor rpm		530 - 895	590 - 955
	Total Motor watts		210 - 860	555 - 1740
	Diameter - (No.) in.		(6) 24	(6) 24
	Number of blades		3	3
	Total Air volume - cfm		16,000	19,500
<b>Indoor Coils</b>	Net face area (total) - sq. ft.		21.4	21.4
	Tube diameter - in.		3/8	3/8
	Number of rows		4	4
	Fins per inch		14	14
	Drain connection - No. and size		(1) 1 in. FPT	(1) 1 in. FPT
	Expansion device type		Balance port TXV, removable head	
<sup>3</sup> <b>Indoor Blower and Drive Selection</b>	Nominal motor output		3 hp, 5 hp, 7.5 hp	5 hp, 7.5 hp, 10 hp
	Maximum usable motor output (US Only)		3.45 hp, 5.75 hp, 8.62 hp	5.75 hp, 8.62 hp, 11.5 hp
	Motor - Drive kit number		<b>3 hp Std. Eff.</b> Kit 1 535-725 rpm Kit 2 710-965 rpm <b>3 hp High. Eff.</b> Kit 3 - 685-856 rpm Kit 4 850-1045 rpm <b>5 hp</b> Kit 3 685-856 rpm Kit 4 850-1045 rpm Kit 5 945-1185 rpm <b>7.5 hp</b> Kit 6 850-1045 rpm Kit 7 945-1185 rpm Kit 8 1045-1285 rpm	<b>5 hp</b> Kit 3 685-856 rpm Kit 4 850-1045 rpm Kit 5 945-1185 rpm <b>7.5 hp</b> Kit 6 850-1045 rpm Kit 7 945-1185 rpm Kit 8 1045-1285 rpm <b>10 hp</b> Kit 7 945-1185 rpm Kit 10 1045-1285 rpm Kit 11 1135-1365 rpm
	Blower wheel nominal D x W - in.		(2) 15 x 15	(2) 15 x 15
<b>Filters</b>	Type of filter	Fiberglass, disposable		
	Number and size - in.	(6) 24 x 24 x 2		
<b>Electrical characteristics</b>		208/230V, 460V or 575V - 60 hertz - 3 phase		

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

<sup>1</sup> AHRI Certified to AHRI Standard 340/360; 95°F outdoor air temperature and 80°F db/67°F wb entering evaporator air; minimum external duct static pressure.

<sup>2</sup> Integrated Energy Efficiency Ratio tested according to AHRI Standard 340/360.

<sup>3</sup> Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

NOTE - MSAV® (Multi-Stage Air Volume) drive is limited to a motor service factor of 1.0.



## SPECIFICATIONS - GAS HEAT

Usage Data		Model Number	LGH180	LGH180 LGH240		LGH180 LGH240
		Heat Input Type	Low (L)	Standard (S)	Medium (M)	High (H)
		Number of Gas Heat Stages	1	2	2	2
<b>Gas Heating Performance (Two-Stage)</b>	Input - Btuh	First Stage	169,000	169,000	234,000	312,000
		Second Stage	N/A	260,000	360,000	480,000
	Output - Btuh	First Stage	135,000	---	---	---
		Second Stage	N/A	208,000	288,000	384,000
<b><sup>1</sup> Gas Heating Performance (Four-Stage)</b>	Input - Btuh	First Stage	N/A	84,500	117,000	156,000
		Second Stage	N/A	169,000	234,000	312,000
		Third Stage	N/A	214,000	297,000	396,000
		Fourth Stage	N/A	260,000	360,000	480,000
	Output - Btuh	First Stage	135,000	67,000	93,000	124,000
		Second Stage	N/A	135,000	187,000	249,000
		Third Stage	N/A	171,000	237,000	316,000
		Fourth Stage	N/A	208,000	288,000	384,000
Temperature Rise Range - °F			15 - 45	15 - 45	30 - 60	40 - 70
Thermal Efficiency			80.0%	80.0%	80.0%	80.0%
Gas Supply Connections			1 in. npt	1 in. npt	1 in. npt	1 in. npt
Recommended Gas Supply Pressure - in. w.g.	Natural		7	7	7	7
	LPG/Propane		11	11	11	11

<sup>1</sup> Four-Stage Gas Heating is field configured.

## HIGH ALTITUDE DERATE

Units may be installed at altitudes up to 2000 feet above sea level without any modification.

At altitudes above 2000 feet, units must be derated to match gas manifold pressures shown in table below.

At altitudes above 4500 feet unit must be derated 2% for each 1000 feet above sea level.

NOTE – This is the only permissible derate for these units.

### TWO-STAGE

Gas Heat Type (Two-Stage)	Altitude - ft.	Gas Manifold Pressure - in. w.g.		Input Rate Natural Gas or LPG/Propane - Btuh	
		Natural Gas	LPG/Propane Gas	First Stage	Second Stage
Low (L)		No adjustment required			
Standard (S)	2001 - 4500	3.4	9.6	169,000	249,000
Medium (M)	2001 - 4500	3.4	9.6	234,000	345,000
High (H)	2001 - 4500	3.4	9.6	312,000	460,000

### FOUR-STAGE

<sup>1</sup> Gas Heat Type (Four-Stage)	Altitude - ft.	Gas Manifold Pressure - in. w.g.		Input Rate Natural Gas or LPG/Propane - Btuh			
		Natural Gas	LPG/Propane Gas	First Stage	Second Stage	Third Stage	Fourth Stage
Low (L)		No adjustment required					
Standard (S)	2001 - 4500	3.4	9.6	84,000	169,000	209,000	249,000
Medium (M)	2001 - 4500	3.4	9.6	117,000	234,000	289,000	345,000
High (H)	2001 - 4500	3.4	9.6	156,000	312,000	386,000	460,000

<sup>1</sup> Four-Stage Gas Heating is field configured.

# RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Product Data section.

## 15 TON ULTRA-HIGH EFFICIENCY LGH180U4M (1 COMPRESSOR OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	2000	54.5	2.1	0.85	0.99	1	48.6	2.38	0.85	1	1	43	2.69	0.86	1	1	37.3	3.04	0.87	1	1
	2200	56.4	2.1	0.88	1	1	50.8	2.38	0.89	1	1	45.1	2.69	0.9	1	1	39.2	3.04	0.92	1	1
	2400	58.5	2.1	0.91	1	1	52.7	2.38	0.92	1	1	46.9	2.69	0.93	1	1	40.9	3.04	0.95	1	1
67°F	2000	58.7	2.1	0.65	0.83	0.97	52.6	2.38	0.63	0.83	0.98	46.4	2.69	0.61	0.84	1	39.8	3.04	0.59	0.85	1
	2200	60.2	2.1	0.67	0.86	0.99	54	2.38	0.66	0.87	1	47.6	2.69	0.64	0.89	1	41	3.04	0.62	0.9	1
	2400	61.5	2.1	0.69	0.89	1	55.1	2.39	0.68	0.91	1	48.7	2.69	0.67	0.92	1	42	3.04	0.65	0.94	1
71°F	2000	63.1	2.1	0.48	0.65	0.81	56.9	2.39	0.45	0.64	0.82	50.5	2.69	0.41	0.62	0.82	44	3.04	0.35	0.6	0.84
	2200	64.7	2.11	0.49	0.67	0.84	58.4	2.39	0.46	0.66	0.85	51.9	2.69	0.42	0.65	0.87	45.2	3.04	0.37	0.64	0.88
	2400	66.1	2.11	0.5	0.69	0.88	59.6	2.39	0.47	0.68	0.89	53	2.69	0.44	0.68	0.9	46.3	3.04	0.39	0.67	0.92

## 15 TON ULTRA-HIGH EFFICIENCY LGH180U4M (2 COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	2400	100.5	3.88	0.68	0.82	0.95	92.9	4.4	0.68	0.83	0.96	85.1	4.98	0.68	0.83	0.99	76.8	5.64	0.68	0.85	1
	3000	107.4	3.89	0.74	0.89	1	99.5	4.41	0.74	0.91	1	91.1	4.98	0.75	0.93	1	82.6	5.64	0.76	0.95	1
	3600	113.3	3.9	0.79	0.96	1	104.6	4.42	0.8	0.98	1	96.2	4.99	0.81	1	1	88.3	5.64	0.83	1	1
67°F	2400	109.4	3.89	0.54	0.66	0.78	101.3	4.41	0.53	0.66	0.79	93.1	4.99	0.52	0.66	0.8	84.6	5.64	0.5	0.65	0.82
	3000	116.6	3.9	0.57	0.71	0.85	108.1	4.42	0.57	0.72	0.87	99.2	4.99	0.56	0.73	0.89	89.9	5.64	0.55	0.74	0.92
	3600	121.7	3.91	0.61	0.77	0.92	112.8	4.43	0.6	0.78	0.95	103.8	5	0.6	0.79	0.97	94.1	5.64	0.6	0.81	1
71°F	2400	118.2	3.9	0.41	0.53	0.64	110.1	4.42	0.4	0.52	0.64	101.5	4.99	0.38	0.51	0.64	92.5	5.64	0.35	0.5	0.64
	3000	125.9	3.91	0.43	0.56	0.69	117	4.43	0.42	0.56	0.7	107.9	5	0.4	0.55	0.71	98.5	5.64	0.38	0.55	0.72
	3600	131.3	3.92	0.44	0.6	0.75	122.2	4.44	0.43	0.6	0.76	112.4	5	0.42	0.6	0.77	102.8	5.65	0.4	0.6	0.78

## 15 TON ULTRA-HIGH EFFICIENCY LGH180U4M (3 COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	3600	149.1	5.97	0.7	0.83	0.95	139.5	6.75	0.7	0.84	0.97	129.5	7.61	0.7	0.85	0.99	118.9	8.6	0.71	0.87	1
	4500	158.3	6	0.75	0.89	1	148	6.77	0.75	0.92	1	137.7	7.64	0.76	0.94	1	126.5	8.63	0.78	0.96	1
	5400	165.7	6.02	0.8	0.96	1	155.2	6.8	0.81	0.98	1	144.6	7.66	0.82	1	1	134.2	8.64	0.84	1	1
67°F	3600	160.8	6.01	0.55	0.67	0.79	150.7	6.78	0.55	0.68	0.81	140.4	7.65	0.54	0.68	0.82	129.4	8.63	0.53	0.69	0.83
	4500	170.4	6.03	0.58	0.72	0.86	159.6	6.81	0.58	0.73	0.88	148.1	7.66	0.58	0.74	0.9	136.4	8.65	0.58	0.76	0.93
	5400	177	6.05	0.62	0.78	0.93	166	6.83	0.62	0.79	0.95	154.2	7.68	0.61	0.8	0.98	142.1	8.66	0.62	0.82	1
71°F	3600	172.4	6.04	0.42	0.54	0.65	162.1	6.81	0.42	0.53	0.65	151	7.68	0.4	0.53	0.66	139.8	8.66	0.39	0.53	0.66
	4500	182.5	6.07	0.44	0.57	0.7	171.4	6.84	0.43	0.57	0.71	159.8	7.7	0.41	0.57	0.72	147.6	8.68	0.41	0.57	0.74
	5400	189.7	6.09	0.45	0.61	0.76	177.9	6.86	0.45	0.61	0.77	165.6	7.72	0.44	0.61	0.79	152.9	8.69	0.43	0.62	0.8

## 15 TON ULTRA-HIGH EFFICIENCY LGH180U4M (ALL COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	183	10.35	0.71	0.86	0.99	170	11.7	0.72	0.88	1	156.4	13.27	0.73	0.9	1	142.1	15.1	0.75	0.93	1
	6000	193.6	10.39	0.77	0.94	1	180	11.74	0.78	0.96	1	166.1	13.31	0.8	0.99	1	152	15.13	0.83	1	1
	7200	202.3	10.43	0.83	1	1	189.5	11.77	0.85	1	1	176.1	13.33	0.87	1	1	162	15.16	0.91	1	1
67°F	4800	197.1	10.41	0.55	0.69	0.82	183.6	11.75	0.55	0.7	0.84	169.4	13.32	0.55	0.71	0.86	154	15.13	0.55	0.73	0.9
	6000	207.7	10.44	0.59	0.75	0.9	193.1	11.78	0.59	0.76	0.93	177.7	13.34	0.6	0.78	0.96	161.9	15.16	0.6	0.81	0.99
	7200	215.4	10.47	0.63	0.81	0.97	199.9	11.81	0.63	0.83	1	184.1	13.36	0.64	0.85	1	167.7	15.18	0.65	0.88	1
71°F	4800	211.5	10.46	0.41	0.54	0.67	197.3	11.81	0.4	0.54	0.67	182.4	13.35	0.4	0.54	0.69	166.8	15.17	0.38	0.55	0.7
	6000	222.3	10.5	0.44	0.58	0.72	207.6	11.84	0.42	0.59	0.74	191.4	13.39	0.42	0.59	0.76	174.8	15.21	0.41	0.6	0.79
	7200	230.5	10.53	0.44	0.62	0.79	214.6	11.87	0.44	0.63	0.81	197.9	13.41	0.44	0.64	0.83	180.7	15.22	0.43	0.65	0.86

# RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Product Data section.

## 20 TON ULTRA-HIGH EFFICIENCY LGH240U4M (1 COMPRESSOR OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	2600	71.2	2.28	0.8	0.97	1	66.6	2.65	0.81	0.99	1	62	3.05	0.82	1	1	57.5	3.49	0.84	1	1
	2900	73.3	2.28	0.83	1	1	69	2.65	0.84	1	1	64.4	3.05	0.86	1	1	59.8	3.49	0.89	1	1
	3200	75.8	2.27	0.86	1	1	71.3	2.64	0.88	1	1	66.7	3.05	0.9	1	1	62	3.49	0.93	1	1
67°F	2600	75.7	2.27	0.62	0.78	0.94	70.9	2.65	0.62	0.79	0.96	65.8	3.05	0.62	0.8	0.98	60.7	3.49	0.62	0.82	1
	2900	77.8	2.27	0.64	0.81	0.98	72.7	2.64	0.64	0.82	1	67.5	3.05	0.64	0.84	1	62.1	3.49	0.65	0.86	1
	3200	79.4	2.26	0.66	0.84	1	74.2	2.64	0.66	0.86	1	68.9	3.04	0.66	0.88	1	63.5	3.48	0.67	0.9	1
71°F	2600	80.4	2.26	0.46	0.61	0.76	75.5	2.64	0.45	0.61	0.77	70.3	3.04	0.44	0.61	0.78	65.1	3.48	0.42	0.61	0.79
	2900	82.7	2.25	0.47	0.63	0.79	77.6	2.63	0.46	0.63	0.8	72.2	3.04	0.45	0.64	0.82	66.9	3.48	0.44	0.64	0.84
	3200	84.5	2.24	0.48	0.65	0.82	79.3	2.62	0.47	0.65	0.83	73.9	3.03	0.46	0.66	0.85	68.3	3.47	0.45	0.67	0.88

## 20 TON ULTRA-HIGH EFFICIENCY LGH240U4M (2 COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	3200	134.6	4.66	0.67	0.81	0.95	127.6	5.39	0.68	0.82	0.97	120.5	6.2	0.68	0.84	0.99	112.8	7.07	0.69	0.86	1
	4000	143.1	4.66	0.72	0.88	1	135.6	5.4	0.73	0.9	1	127.9	6.21	0.74	0.93	1	120.1	7.09	0.76	0.95	1
	4800	150	4.66	0.77	0.96	1	142.1	5.41	0.79	0.98	1	134.3	6.22	0.8	1	1	126.9	7.1	0.81	1	1
67°F	3200	145.1	4.66	0.53	0.65	0.77	137.6	5.41	0.53	0.66	0.78	130	6.21	0.53	0.66	0.8	122	7.09	0.53	0.67	0.81
	4000	154.2	4.66	0.56	0.69	0.84	146.2	5.41	0.57	0.71	0.86	137.6	6.22	0.57	0.72	0.88	129	7.1	0.57	0.73	0.91
	4800	160.4	4.64	0.59	0.75	0.92	151.9	5.4	0.6	0.76	0.94	143.5	6.22	0.59	0.78	0.97	134.3	7.1	0.61	0.79	0.99
71°F	3200	156	4.65	0.42	0.52	0.63	148.1	5.4	0.41	0.52	0.63	140.1	6.22	0.39	0.52	0.64	132.1	7.1	0.4	0.52	0.64
	4000	165.7	4.63	0.42	0.55	0.67	157.3	5.39	0.42	0.55	0.68	148.4	6.21	0.41	0.55	0.69	139.8	7.1	0.4	0.56	0.71
	4800	172.8	4.61	0.43	0.58	0.72	163.9	5.37	0.43	0.59	0.73	154.7	6.2	0.43	0.59	0.75	145.3	7.09	0.43	0.6	0.77

## 20 TON ULTRA-HIGH EFFICIENCY LGH240U4M (3 COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	194	7.68	0.71	0.84	0.96	184.8	8.83	0.72	0.85	0.98	175.1	10.08	0.73	0.87	0.99	165.2	11.45	0.74	0.89	1
	6000	205.2	7.73	0.76	0.9	1	195.1	8.89	0.77	0.92	1	185.2	10.14	0.78	0.94	1	174.4	11.52	0.8	0.97	1
	7200	214.4	7.77	0.81	0.97	1	204	8.93	0.82	0.99	1	193.5	10.19	0.84	1	1	183.5	11.57	0.86	1	1
67°F	4800	208.3	7.75	0.57	0.69	0.81	198.3	8.9	0.57	0.69	0.82	188.4	10.16	0.57	0.7	0.83	177.6	11.54	0.57	0.71	0.85
	6000	220.3	7.78	0.6	0.73	0.87	209.3	8.94	0.6	0.74	0.88	198.6	10.21	0.6	0.76	0.91	186.7	11.59	0.61	0.77	0.93
	7200	229	7.81	0.62	0.78	0.93	217.4	8.97	0.63	0.8	0.95	206.1	10.24	0.64	0.82	0.98	193.7	11.62	0.65	0.83	1
71°F	4800	223	7.79	0.44	0.55	0.66	212.5	8.96	0.43	0.55	0.67	202	10.23	0.43	0.55	0.68	190.7	11.61	0.42	0.56	0.69
	6000	235.8	7.82	0.45	0.58	0.71	224.6	8.99	0.45	0.59	0.72	212.9	10.26	0.44	0.59	0.73	200.8	11.65	0.45	0.6	0.75
	7200	244.7	7.83	0.46	0.61	0.75	233	9	0.46	0.62	0.77	221.2	10.28	0.46	0.63	0.79	208.4	11.67	0.46	0.64	0.81

## 20 TON ULTRA -HIGH EFFICIENCY LGH240U4M (ALL COMPRESSORS OPERATING) - MSAV (Multi-Stage Air Volume)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	6400	237.1	13.72	0.69	0.84	0.99	224.5	15.55	0.69	0.86	1	211.1	17.57	0.71	0.89	1	196.8	19.78	0.73	0.92	1
	8000	250.4	13.83	0.74	0.93	1	237	15.67	0.75	0.96	1	222.5	17.69	0.78	0.99	1	208.6	19.91	0.81	1	1
	9600	261.1	13.92	0.8	1	1	248	15.76	0.82	1	1	234.6	17.8	0.85	1	1	220.6	20.03	0.88	1	1
67°F	6400	254.9	13.86	0.54	0.66	0.8	241	15.71	0.54	0.67	0.82	227.2	17.73	0.55	0.69	0.84	211.6	19.94	0.55	0.7	0.88
	8000	268.1	13.97	0.56	0.71	0.88	253	15.81	0.57	0.73	0.91	237.7	17.81	0.58	0.75	0.94	221.8	20.04	0.6	0.78	0.98
	9600	277.3	14.03	0.6	0.77	0.96	262.5	15.87	0.61	0.79	0.99	246.2	17.89	0.62	0.82	1	228.4	20.1	0.63	0.86	1
71°F	6400	272.3	14	0.41	0.52	0.64	257.9	15.84	0.41	0.52	0.65	243.8	17.88	0.4	0.53	0.66	227.1	20.08	0.4	0.54	0.68
	8000	286.3	14.08	0.42	0.56	0.69	270.8	15.92	0.42	0.56	0.7	254.9	17.95	0.42	0.57	0.72	238.4	20.18	0.42	0.58	0.75
	9600	296	14.12	0.43	0.58	0.74	280.9	15.99	0.43	0.6	0.76	264.2	18.02	0.43	0.61	0.79	245.7	20.23	0.43	0.63	0.82

## BLOWER DATA

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL & AIR FILTERS IN PLACE FOR ALL UNITS ADD:

- 1 - Wet indoor coil air resistance of selected unit.
- 2 - Any factory installed options air resistance (heat section, economizer, etc.)
- 3 - Any field installed accessories air resistance (heat section, duct resistance, diffuser, etc.)

Then determine from blower table blower motor output and drive required.

See page 8 for wet coil and option/accessory air resistance data.

See page 8 for factory installed drive kit specifications.

### MINIMUM AIR VOLUME REQUIRED FOR DIFFERENT GAS HEAT SIZES

Low (L), Standard (S) and Medium Heat (M) - 4500 cfm minimum

High Heat (H) - 5125 cfm minimum

TOTAL STATIC PRESSURE - Inches Water Gauge (Pa)

Air Volume cfm	0.20		0.40		0.60		0.80		1.00		1.20		1.40		1.60		1.80		2.00		2.20		2.40		2.60			
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
2750	385	0.30	505	0.50	600	0.70	680	0.90	755	1.10	820	1.30	885	1.70	950	2.10	1005	2.55	1060	3.00	1110	3.30	1160	3.85	1205	4.15	1250	4.45
3000	395	0.35	515	0.55	610	0.75	685	1.00	760	1.20	825	1.45	890	1.85	955	2.25	1010	2.70	1065	3.15	1115	3.55	1165	4.10	1210	4.45	1255	4.75
3250	405	0.40	520	0.60	615	0.85	695	1.10	765	1.30	830	1.60	895	2.00	960	2.40	1015	2.85	1070	3.30	1120	3.70	1170	4.25	1220	4.55	1265	4.85
3500	415	0.45	530	0.70	620	0.95	700	1.20	775	1.45	840	1.70	900	2.15	965	2.55	1020	3.00	1075	3.45	1125	3.85	1175	4.40	1225	4.70	1270	5.00
3750	425	0.50	540	0.75	630	1.05	710	1.30	780	1.60	845	1.85	905	2.30	970	2.70	1025	3.15	1080	3.60	1130	4.00	1180	4.55	1230	4.85	1275	5.15
4000	435	0.55	545	0.85	635	1.10	715	1.40	785	1.70	850	2.00	910	2.45	975	2.85	1030	3.30	1085	3.75	1135	4.15	1185	4.70	1235	5.00	1280	5.30
4250	445	0.60	555	0.90	645	1.25	725	1.55	795	1.85	855	2.15	915	2.65	980	3.05	1035	3.50	1090	3.95	1140	4.35	1190	4.90	1240	5.20	1285	5.50
4500	455	0.70	565	1.00	655	1.35	730	1.65	800	2.00	865	2.35	925	2.85	990	3.25	1040	3.70	1095	4.15	1145	4.55	1195	5.10	1245	5.40	1290	5.70
4750	470	0.75	575	1.10	660	1.45	740	1.80	810	2.15	870	2.50	930	3.05	995	3.45	1045	3.90	1100	4.35	1150	4.75	1200	5.30	1250	5.60	1295	5.90
5000	480	0.85	585	1.25	670	1.60	750	1.95	815	2.30	880	2.70	940	3.05	1000	3.65	1050	4.00	1105	4.45	1155	4.85	1205	5.40	1255	5.70	1300	6.00
5250	495	0.95	595	1.35	680	1.70	755	2.10	825	2.50	890	2.90	945	3.25	1000	3.85	1050	4.30	1105	4.75	1155	5.15	1205	5.70	1255	6.00	1300	6.30
5500	505	1.05	605	1.45	690	1.85	765	2.25	835	2.65	895	3.05	955	3.45	1010	3.95	1060	4.40	1110	4.85	1160	5.25	1210	5.80	1260	6.10	1305	6.40
5750	520	1.15	615	1.60	700	2.00	775	2.45	840	2.85	905	3.25	960	3.65	1015	4.15	1065	4.60	1115	5.05	1165	5.45	1215	6.00	1265	6.30	1310	6.60
6000	530	1.30	630	1.75	710	2.15	785	2.60	850	3.05	910	3.45	970	3.90	1025	4.35	1075	4.80	1120	5.20	1170	5.65	1220	6.20	1270	6.50	1315	6.80
6250	545	1.40	640	1.90	720	2.35	795	2.80	860	3.25	920	3.70	975	4.15	1030	4.60	1080	5.05	1130	5.50	1175	5.95	1225	6.50	1275	6.80	1320	7.10
6500	560	1.55	650	2.05	730	2.50	805	3.00	870	3.45	930	3.95	985	4.40	1040	4.85	1090	5.35	1140	5.85	1185	6.30	1235	6.90	1285	7.20	1330	7.50
6750	570	1.70	665	2.20	745	2.70	815	3.20	880	3.70	940	4.20	995	4.65	1045	5.10	1095	5.60	1145	6.10	1190	6.60	1240	7.10	1290	7.40	1335	7.70
7000	585	1.85	675	2.35	755	2.90	825	3.40	890	3.95	950	4.45	1005	4.95	1055	5.40	1105	5.95	1155	6.45	1200	6.95	1250	7.45	1300	7.75	1340	8.05
7250	600	2.00	690	2.60	765	3.10	835	3.65	900	4.15	955	4.65	1015	5.25	1065	5.75	1115	6.25	1160	6.75	1210	7.30	1260	7.85	1310	8.15	1350	8.45
7500	615	2.20	700	2.75	775	3.30	845	3.85	910	4.45	965	4.95	1020	5.50	1075	6.05	1125	6.60	1170	7.15	1215	7.65	1265	8.20	1315	8.50	1355	8.80
7750	630	2.40	715	3.00	790	3.55	855	4.10	920	4.70	975	5.25	1030	5.80	1080	6.35	1130	6.90	1180	7.50	1225	8.05	1275	8.60	1325	8.90	1365	9.20
8000	640	2.55	725	3.20	800	3.80	865	4.35	930	4.95	985	5.50	1040	6.10	1090	6.70	1140	7.25	1185	7.85	1230	8.40	1280	9.00	1330	9.30	1370	9.60
8250	655	2.80	740	3.40	810	4.00	880	4.65	940	5.25	995	5.85	1050	6.45	1100	7.05	1150	7.65	1195	8.25	1240	8.85	1290	9.40	1340	9.70	1380	10.00
8500	670	3.00	750	3.65	825	4.30	890	4.90	950	5.55	1005	6.15	1060	6.80	1110	7.40	1160	8.05	1205	8.65	1250	9.25	1300	9.85	1350	10.15	1390	10.45
8750	685	3.25	765	3.90	835	4.55	900	5.20	960	5.85	1015	6.45	1070	7.15	1120	7.75	1165	8.35	1215	9.05	1255	9.65	1305	10.30	1355	10.60	1400	10.90
9000	700	3.50	780	4.20	850	4.85	910	5.50	970	6.15	1025	6.80	1080	7.50	1130	8.15	1175	8.75	1220	9.40	1265	10.10	1310	10.80	1360	11.10	1405	11.40
9250	715	3.75	790	4.45	860	5.15	925	5.85	985	6.55	1040	7.20	1095	7.85	1140	8.55	1185	9.20	1230	9.85	1275	10.55	1320	11.20	1370	11.50	1410	11.80
9500	730	4.00	805	4.75	875	5.45	935	6.15	995	6.90	1050	7.60	1105	8.25	1150	8.95	1195	9.60	1240	10.30	1285	11.05	1330	11.50	1380	11.80	1420	12.10
9750	745	4.30	820	5.05	885	5.75	950	6.55	1005	7.20	1060	7.95	1110	8.65	1160	9.40	1205	10.05	1250	10.80	1295	11.50	1340	12.00	1390	12.30	1430	12.60
10,000	760	4.60	835	5.40	900	6.15	960	6.85	1015	7.60	1070	8.35	1120	9.05	1170	9.80	1215	10.50	1260	11.25	1305	12.00	1350	12.50	1400	12.80	1440	13.10
10,250	775	4.90	845	5.65	910	6.45	970	7.20	1030	8.00	1080	8.75	1135	9.55	1180	10.25	1225	11.00	1270	11.75	1315	12.50	1360	13.00	1410	13.30	1450	13.60
10,500	790	5.20	860	6.00	925	6.85	985	7.65	1040	8.40	1095	9.20	1145	10.00	1190	10.70	1235	11.45	1280	12.25	1320	13.00	1370	13.50	1420	13.80	1460	14.10
10,750	805	5.55	875	6.40	940	7.25	1000	8.05	1055	8.85	1105	9.65	1155	10.45	1200	11.20	1245	12.20	1290	13.00	1330	13.75	1380	14.25	1430	14.55	1470	14.85
11,000	820	5.90	890	6.80	950	7.60	1010	8.45	1065	9.30	1115	10.05	1165	10.90	1210	11.90	1255	13.15	1300	13.90	1340	14.65	1390	15.00	1440	15.30	1480	15.60

## BLOWER DATA

### FACTORY INSTALLED BELT DRIVE KIT SPECIFICATIONS

Motor Efficiency	Nominal hp	Maximum hp	Drive Kit Number	RPM Range
Standard	3	3.45	1	535 - 725
Standard	3	3.45	2	710 - 965
High	3	3.45	3	685 - 856
High	3	3.45	4	850 - 1045
Standard	5	5.75	3	685 - 856
Standard	5	5.75	4	850 - 1045
Standard	5	5.75	5	945 - 1185
Standard	7.5	8.63	6	850 - 1045
Standard	7.5	8.63	7	945 - 1185
Standard	7.5	8.63	8	1045 - 1285
Standard	10	11.50	7	945 - 1185
Standard	10	11.50	10	1045 - 1285
Standard	10	11.50	11	1135 - 1365

NOTE - Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

NOTE – MSAV® (Multi-Stage Air Volume) drive is limited to a motor service factor of 1.0.

### FACTORY INSTALLED OPTIONS/FIELD INSTALLED ACCESSORY AIR RESISTANCE

Air Volume cfm	Wet Indoor Coil in. w.g.	Gas Heat Exchanger			Economizer in. w.g.	Filters		Horizontal Roof Curb in. w.g.
		Low/Standard Heat	Medium Heat	High Heat		MERV 8	MERV 13	
		in. w.g.	in. w.g.	in. w.g.				
2750	.02	.02	.04	.05	---	.01	.03	.03
3000	.02	.03	.04	.05	---	.01	.03	.04
3250	.03	.03	.05	.06	---	.01	.04	.04
3500	.03	.03	.05	.06	---	.01	.04	.05
3750	.03	.04	.06	.07	---	.01	.04	.05
4000	.04	.04	.06	.07	---	.01	.04	.06
4250	.04	.04	.06	.08	---	.01	.05	.07
4500	.05	.05	.07	.09	---	.01	.05	.07
4750	.05	.05	.08	.10	---	.02	.05	.08
5000	.05	.05	.09	.11	---	.02	.06	.08
5250	.06	.06	.10	.12	---	.02	.06	.09
5500	.07	.06	.10	.13	---	.02	.06	.10
5750	.07	.06	.11	.14	---	.02	.07	.11
6000	.08	.07	.12	.15	---	.03	.07	.11
6250	.08	.07	.12	.16	.01	.03	.07	.12
6500	.09	.08	.13	.17	.02	.03	.08	.13
6750	.10	.08	.14	.18	.03	.03	.08	.14
7000	.10	.09	.15	.19	.04	.04	.08	.15
7250	.11	.09	.16	.20	.05	.04	.09	.16
7500	.12	.10	.17	.21	.06	.04	.09	.17
8000	.13	.11	.19	.24	.09	.05	.10	.19
8500	.15	.12	.20	.26	.11	.05	.10	.21
9000	.16	.13	.23	.29	.14	.06	.11	.24
9500	.18	.14	.25	.32	.16	.07	.12	.26
10,000	.20	.16	.27	.35	.19	.07	.12	.29
10,500	.22	.17	.30	.38	.22	.08	.13	.31
11,000	.24	.18	.31	.40	.25	.09	.14	.34



## BLOWER DATA

### POWER EXHAUST FAN PERFORMANCE

Return Air System Static Pressure	Air Volume Exhausted
in. w.g.	cfm
0.00	8630
0.05	8210
0.10	7725
0.15	7110
0.20	6470
0.25	5790
0.30	5060
0.35	4300
0.40	3510
0.45	2690
0.50	1840

### CEILING DIFFUSER AIR RESISTANCE - in. w.g.

Air Volume cfm	Step-Down Diffuser						Flush Diffuser	
	RTD11-185S			RTD11-275			FD11-185S	FD11-275
	2 Ends Open	1 Side/2 Ends Open	All Ends & Sides Open	2 Ends Open	1 Side/2 Ends Open	All Ends & Sides Open		
5000	.51	.44	.39	---	---	---	.27	---
5200	.56	.48	.42	---	---	---	.30	---
5400	.61	.52	.45	---	---	---	.33	---
5600	.66	.56	.48	---	---	---	.36	---
5800	.71	.59	.51	---	---	---	.39	---
6000	.76	.63	.55	.36	.31	.27	.42	.29
6200	.80	.68	.59	---	---	---	.46	---
6400	.86	.72	.63	---	---	---	.50	---
6500	---	---	---	.42	.36	.31	---	.34
6600	.92	.77	.67	---	---	---	.54	---
6800	.99	.83	.72	---	---	---	.58	---
7000	1.03	.87	.76	.49	.41	.36	.62	.40
7200	1.09	.92	.80	---	---	---	.66	---
7400	1.15	.97	.84	---	---	---	.70	---
7500	---	---	---	.51	.46	.41	---	.45
7600	1.20	1.02	.88	---	---	---	.74	---
8000	---	---	---	.59	.49	.43	---	.50
8500	---	---	---	.69	.58	.50	---	.57
9000	---	---	---	.79	.67	.58	---	.66
9500	---	---	---	.89	.75	.65	---	.74
10,000	---	---	---	1.00	.84	.73	---	.81
10,500	---	---	---	1.10	.92	.80	---	.89
11,000	---	---	---	1.21	1.01	.88	---	.96

### CEILING DIFFUSER AIR THROW DATA - ft.

Model No.	Air Volume cfm	<sup>1</sup> Effective Throw Range - ft.		Model No.	Air Volume cfm	<sup>1</sup> Effective Throw Range - ft.	
		RTD11-185S Step-Down	FD11-185S Flush			RTD11-275 Step-Down	FD11-275 Flush
180	5600	39 - 49	28 - 37	240	7200	33 - 38	26 - 35
	5800	42 - 51	29 - 38		7400	35 - 40	28 - 37
	6000	44 - 54	40 - 50		7600	36 - 41	29 - 38
	6200	45 - 55	42 - 51		7800	38 - 43	40 - 50
	6400	46 - 55	43 - 52		8000	39 - 44	42 - 51
	6600	47 - 56	45 - 56		8200	41 - 46	43 - 52
					8400	43 - 49	44 - 54
					8600	44 - 50	46 - 57
					8800	47 - 55	48 - 59

<sup>1</sup> Throw is the horizontal or vertical distance an airstream travels on leaving the outlet diffuser before the maximum velocity is reduced to 50 ft. per minute. Four sides open.

**ELECTRICAL DATA****15 TON****15 TON ULTRA HIGH EFFICIENCY (R-410A)****LGH180U4M**

<sup>1</sup> Voltage - 60hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1	Rated Load Amps	13.1			6.1			4.4		
	Locked Rotor Amps	83.1			41			33		
Compressor 2	Rated Load Amps	13.1			6.1			4.4		
	Locked Rotor Amps	83.1			41			33		
Compressor 3	Rated Load Amps	13.1			6.1			4.4		
	Locked Rotor Amps	83.1			41			33		
Compressor 4	Rated Load Amps	13.1			6.1			4.4		
	Locked Rotor Amps	83.1			41			33		
Outdoor Fan Motors (6)	Full Load Amps (total)	2.8 (16.8)			1.4 (8.4)			1.1 (6.6)		
Power Exhaust (2) 0.33 HP	Full Load Amps (total)	2.4 (4.8)			1.3 (2.6)			1 (2)		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	Horsepower	3	5	7.5	3	5	7.5	3	5	7.5
	Full Load Amps	10.6	16.7	24.2	4.8	7.6	11	3.9	6.1	9
<sup>2</sup> Maximum Overcurrent Protection	Unit Only	90	100	110	45	45	50	30	35	40
	With (2) 0.33 HP Power Exhaust	100	110	125	45	50	60	35	35	45
<sup>3</sup> Minimum Circuit Ampacity	Unit Only	84	91	100	40	43	47	30	32	36
	With (2) 0.33 HP Power Exhaust	88	95	105	42	45	50	32	34	38

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.<sup>2</sup> HACR type breaker or fuse.<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.**ELECTRICAL DATA****20 TON****20 TON ULTRA HIGH EFFICIENCY (R-410A)****LGH240U4M**

<sup>1</sup> Voltage - 60hz		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
Compressor 1	Rated Load Amps	13.5			8			5		
	Locked Rotor Amps	109			59			40		
Compressor 2	Rated Load Amps	13.5			8			5		
	Locked Rotor Amps	109			59			40		
Compressor 3	Rated Load Amps	13.5			8			5		
	Locked Rotor Amps	109			59			40		
Compressor 4	Rated Load Amps	13.5			8			5		
	Locked Rotor Amps	109			59			40		
Outdoor Fan Motors (6)	Full Load Amps (total)	2.8 (16.8)			1.4 (8.4)			1.1 (6.6)		
Power Exhaust (2) 0.33 HP	Full Load Amps (total)	2.4 (4.8)			1.3 (2.6)			1 (2)		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	Horsepower	5	7.5	10	5	7.5	10	5	7.5	10
	Full Load Amps	16.7	24.2	30.8	7.6	11	14	6.1	9	11
<sup>2</sup> Maximum Overcurrent Protection	Unit Only	100	125	125	50	60	70	40	45	50
	With (2) 0.33 HP Power Exhaust	110	125	125	60	60	70	40	45	50
<sup>3</sup> Minimum Circuit Ampacity	Unit Only	92	102	110	50	55	58	35	38	41
	With (2) 0.33 HP Power Exhaust	97	106	115	53	57	61	37	40	43

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.<sup>2</sup> HACR type breaker or fuse.<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.<sup>4</sup> Factory installed circuit breaker not available.


## ELECTRICAL ACCESSORIES

### DISCONNECTS

Voltage	208V	230V	208V	230V	208V	230V	460V	460V	460V	575V	575V	575V
Model No.	LGH180U4M											
Blower Motor HP	3		5		7.5		3	5	7.5	3	5	7.5
Unit Only	54W88	54W88	54W88	54W88	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W88	54W88	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Model No.	LGH240U4M											
Blower Motor HP	5		7.5		10		5	7.5	10	5	7.5	10
Unit Only	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88
Unit w/ Power Exhaust	54W89	54W89	54W89	54W89	54W89	54W89	54W88	54W88	54W88	54W88	54W88	54W88

## UNIT CLEARANCES - INCHES (MM)

### Unit With Economizer

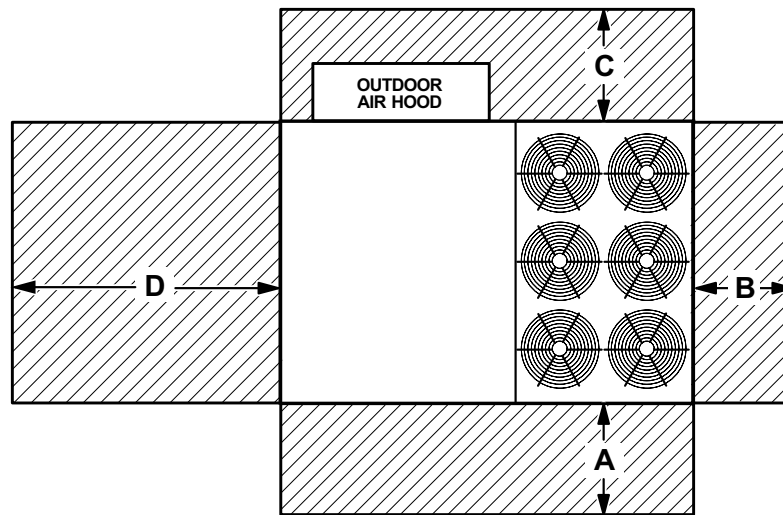

<sup>1</sup> Unit Clearance	A		B		C		D		Top Clearance
	in.	mm	in.	mm	in.	mm	in.	mm	
Service Clearance	60	1524	36	914	36	934	66	1676	Unobstructed
Clearance to Combustibles	36	914	1	25	1	25	1	25	
Minimum Operation Clearance	45	1143	36	914	36	914	41	1041	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

<sup>1</sup> Service Clearance - Required for removal of serviceable parts.

Clearance to Combustibles - Required clearance to combustible material.

Minimum Operation Clearance - Required clearance for proper unit operation.


## OUTDOOR SOUND DATA

Unit Model Number	Octave Band Linear Sound Power Levels dB, re 10 <sup>-12</sup> Watts - Center Frequency - Hz							<sup>1</sup> Sound Rating Number (SRN) (dBA)
	125	250	500	1000	2000	4000	8000	
180	71	76	80	78	74	70	63	86
240	73	81	86	84	78	73	67	90


Note - The octave sound power data does not include tonal corrections.

<sup>1</sup> Sound Rating Number according to ARI Standard 370-2001 (includes pure tone penalty). "SRN" is the overall A-Weighted Sound Power Level, (LWA), dB (100 Hz to 10,000 Hz).

## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

Item	Model No. (Description)	Catalog No.
<b>COMFORTSENSE® 8500 COMMERCIAL 7-DAY PROGRAMMABLE THERMOSTAT - ZONING/NON-ZONING</b>		
 <ul style="list-style-type: none"> <li>• Multi-Stage, Universal Thermostat</li> <li>• Zoning and Non-Zoning Models with or without CO<sub>2</sub> Sensing</li> <li>• Intuitive Touchscreen Interface</li> <li>• Menu-driven Programming</li> <li>• Remote Indoor Temperature Sensing (up to nine averaging sensors)</li> <li>• Compressor Short-Cycle Protection</li> <li>• Relative Humidity Sensor</li> <li>• Occupancy Sensor</li> <li>• Outside Air Temperature Display</li> <li>• Scheduling - Two separate schedules for work days or non-work days</li> <li>• Four Time Periods Per Day (non-zoning models, standalone mode)</li> <li>• Scheduled Occupancy Control</li> <li>• Holiday Scheduling</li> <li>• Performance Reports (non-zoning models, standalone mode)</li> <li>• Reminders - Two Custom and Routine System Checkup (non-zoning models)</li> <li>• Dehumidification/Humiditrol® Control</li> <li>• Backlit Display</li> <li>• Wallplate Furnished</li> </ul>	C0STAT04FF1L (Zoning)	<b>14X57</b>
	C0STAT31FF1L (Zoning with Co <sub>2</sub> Sensing)	<b>14X58</b>
	C0STAT03FF1L (Non-Zoning)	<b>14X55</b>
	C0STAT22FF1L (Non-Zoning with Co <sub>2</sub> Sensing)	<b>14X56</b>
<b>Optional Accessories</b>		
<sup>1</sup> Remote non-adjustable wall mount 10k temperature sensor	C0SNZN01AE2	<b>47W37</b>
<sup>1</sup> Remote non-adjustable wall mount 11k temperature sensor	C0SNZN08AE1	<b>94L61</b>
Locking cover (clear)	C0MISC15AE1-	<b>39P21</b>
<sup>1</sup> Up to nine of the same type remote temperature sensors can be connected in parallel.		
<b>Zonebus Network Cable (Purple) - Zoning Models</b>		
Twisted pair 100% shielded communication cable, Red and Black 22 AWG, purple jacket, rated at 75°C, 300V, Plenum rated Insulation - Low smoke PVC, NEC, CMP	500 ft. box - C0MISC05AE1-	<b>23W99</b>
	1000 ft. box - C0MISC06AE1-	<b>24W00</b>
	2500 ft. roll - C0MISC07AE1-	<b>24W01</b>
<b>Sysbus Network Cable (Yellow) - Non-Zoning Models</b>		
Twisted pair 100% shielded communication cable, Red and Black 22 AWG, yellow jacket, rated at 75°C, 300V, Plenum rated Insulation - Low smoke PVC, NEC, CMP	500 ft. box - C0MISC00AE1-	<b>27M19</b>
	1000 ft. box - C0MISC04AE1-	<b>94L63</b>
	2500 ft. roll - C0MISC01AE1-	<b>68M25</b>

## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

Item	Model No.	Catalog No.
<p><b>COMFORTSENSE® 7500 COMMERCIAL 7-DAY PROGRAMMABLE THERMOSTAT</b></p>  <ul style="list-style-type: none"> <li>• Four-Stage Heating / Two-Stage Cooling Universal Multi-Stage</li> <li>• Intuitive Touchscreen Interface</li> <li>• Remote Indoor Temperature Sensing with Averaging</li> <li>• Outside or Discharge Air Temperature Display</li> <li>• Full Seven-Day Programming</li> <li>• Four Time Periods Per Day</li> <li>• Occupancy Scheduling with Economizer Relay Control</li> <li>• Away Mode</li> <li>• Holiday Scheduling</li> <li>• Smooth Setback Recovery (SSR)</li> <li>• Performance Reports</li> <li>• Notifications/Reminders</li> <li>• Dehumidification/Humiditro® Control for Split Systems and Rooftop Units</li> <li>• Economizer Relay Control</li> <li>• Backlit Display</li> <li>• Wallplate Furnished</li> </ul>	C0STAT06FF1L	<b>13H15</b>
<b>Optional Accessories</b>		
<sup>1</sup> Remote non-adjustable wall mount 20k temperature sensor	C0SNZN01AE2-	<b>47W36</b>
<sup>1</sup> Remote non-adjustable wall mount 10k temperature sensor	C0SNZN73AE1-	<b>47W37</b>
Remote non-adjustable discharge air (duct mount) temperature sensor	C0SNDC00AE1-	<b>19L22</b>
Outdoor temperature sensor	C0SNSR03AE1-	<b>X2658</b>
Locking cover (clear)	C0MISC15AE1-	<b>39P21</b>
<sup>1</sup> Remote sensors can be applied in any of the following combinations: One Sensor - (1) 47W36 Two Sensors - (2) 47W37 Three Sensors - (2) 47W36 and (1) 47W37 Four Sensors - (4) 47W36 Five Sensors - (3) 47W36 and (2) 47W37		
<p><b>COMFORTSENSE® 3000 COMMERCIAL 5-2 DAY PROGRAMMABLE THERMOSTAT</b></p>  <ul style="list-style-type: none"> <li>• Two-Stage Heating / Two-Stage Cooling Conventional Systems</li> <li>• Intuitive Interface</li> <li>• 5-2 Day Programming</li> <li>• Program Hold</li> <li>• Remote Indoor Temperature Sensing</li> <li>• Smooth Setback Recovery (SSR)</li> <li>• Economizer Relay Control</li> <li>• Maintenance/Filter/Service Reminders</li> <li>• Backlit Display</li> <li>• Wallplate Furnished</li> <li>• Simple Up and Down Temperature Control.</li> </ul>	C0STAT05FF1L	<b>11Y05</b>
<b>Optional Accessories</b>		
Remote non-adjustable wall mount 10k averaging temperature sensor	C0SNZN73AE1-	<b>47W37</b>
Optional wall mounting plate	C0MISC17AE1-	<b>X2659</b>
<p><b>DIGITAL NON-PROGRAMMABLE THERMOSTAT</b></p>  <ul style="list-style-type: none"> <li>• One-Stage Heating / Cooling Conventional Systems</li> <li>• Intuitive Interface</li> <li>• Automatic Changeover</li> <li>• Backlit Display</li> <li>• Simple Up and Down Temperature Control.</li> </ul>	C0STAT12AE1L	<b>51M32</b>
<b>Optional Accessories</b>		
Outdoor temperature sensor	C0SNSR04AE1-	<b>X2658</b>
Optional wall mounting plate	C0MISC17AE1-	<b>X2659</b>



**WEIGHT DATA**

Model Number	Net		Shipping	
	lbs.	kg	lbs.	kg
180 Base Unit	2390	1084	2590	1175
180 Max. Unit	2725	1236	2925	1327
240 Base Unit	2430	1102	2630	1193
240 Max. Unit	2765	1254	2965	1345

Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit.

**OPTIONS / ACCESSORIES**

Description	Shipping Weight		
	lbs.	kg	
<b>CEILING DIFFUSERS</b>			
<b>Step-Down</b>			
	RTD11-185S	168	76
	RTD11-275S	238	108
<b>Flush</b>			
	FD11-185S	168	76
	FD11-275S	238	108
<b>Transitions</b>			
	C1DIFF33C-1	80	36
	C1DIFF34C-1	75	34

**ECONOMIZER / OUTDOOR AIR / EXHAUST**

<b>Economizer</b>		
Economizer Dampers	102	46
Barometric Relief Dampers (downflow)	30	14
Barometric Relief Dampers (horizontal)	20	9
Outdoor Air Damper Hood (downflow)	65	29
<b>Outdoor Air Dampers</b>		
Outdoor Air Damper Section (downflow) - Automatic (including Hood)	18	39
Outdoor Air Damper Section (downflow) - Manual (including Hood)	10	22
<b>Power Exhaust</b>	62	28
<b>GAS HEAT EXCHANGER (NET WEIGHT)</b>		
Medium Heat (adder over standard heat)	18	8
High Heat (adder over standard heat)	64	29

**MSAV (MULTI-STAGE AIR VOLUME) SUPPLY AIR BLOWER OPTION**

Variable Frequency Drive (VFD) and associated components	10	5
--	----	---

**ROOF CURBS**

<b>Hybrid Roof Curbs, Downflow</b>		
8 in. height	75	34
14 in. height	105	48
18 in. height	125	57
24 in. height	155	70
<b>Adjustable Pitch Curb, Downflow</b>		
14 in. height	262	119
<b>Horizontal, Standard</b>		
26 in. height	470	213
37 in. height	505	229

**PACKAGING**

LTL Packaging (less than truck load)	310	141
--------------------------------------	-----	-----

# DIMENSIONS - UNIT - INCHES (MM)


## CORNER WEIGHTS

## CENTER OF GRAVITY


Model No.	AA		BB		CC		DD		EE		FF	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
LGH180 Base Unit	467	212	512	232	738	335	673	305	56-1/2	1334	37-1/2	953
LGH180 Max. Unit	579	263	612	278	788	357	746	338	55-1/2	1410	40	1016
LGH240 Base Unit	505	229	505	229	710	322	710	322	53-3/4	1365	38	965
LGH240 Max. Unit	623	283	601	273	756	343	785	356	52-3/4	1340	40-1/2	1029

Base Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust Fans, Controls, etc.). Does not include accessories external to unit.

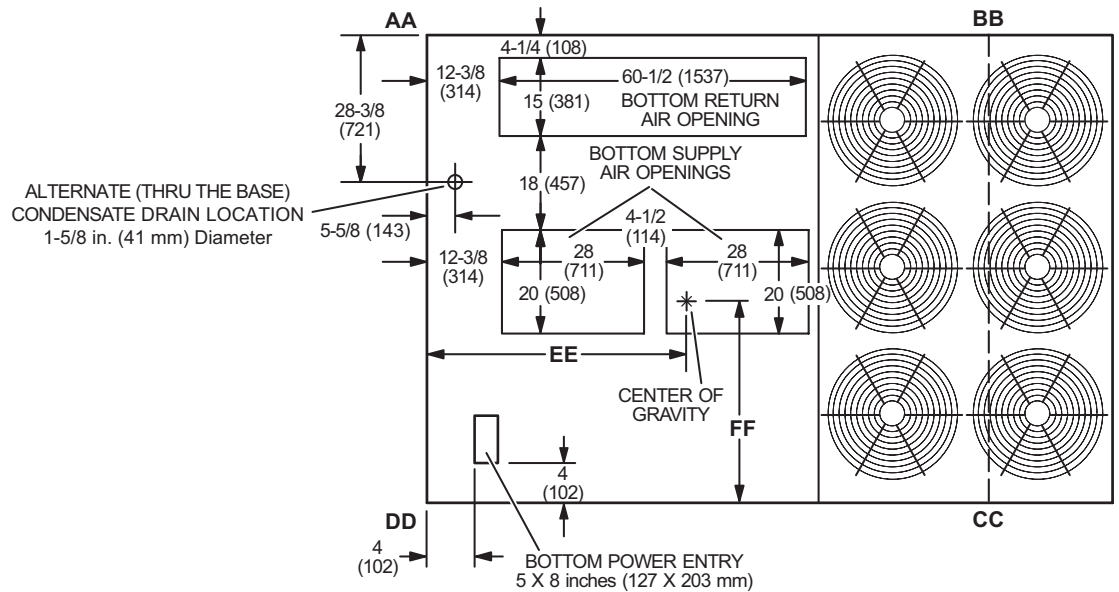

TOP VIEW

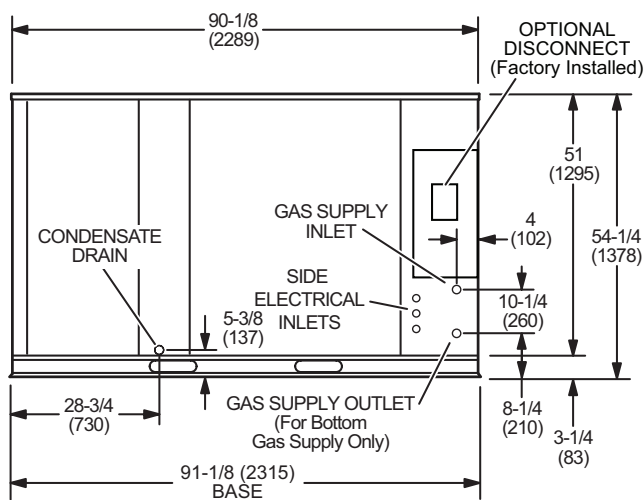


END VIEW

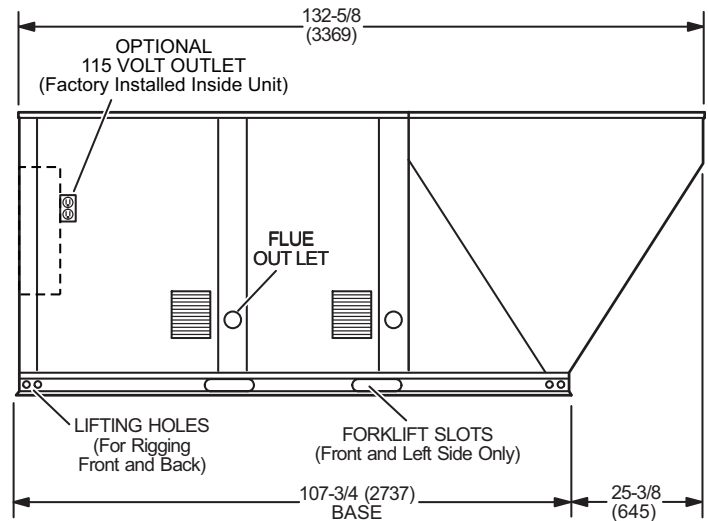


SIDE VIEW

**OUTDOOR AIR HOOD DETAIL**

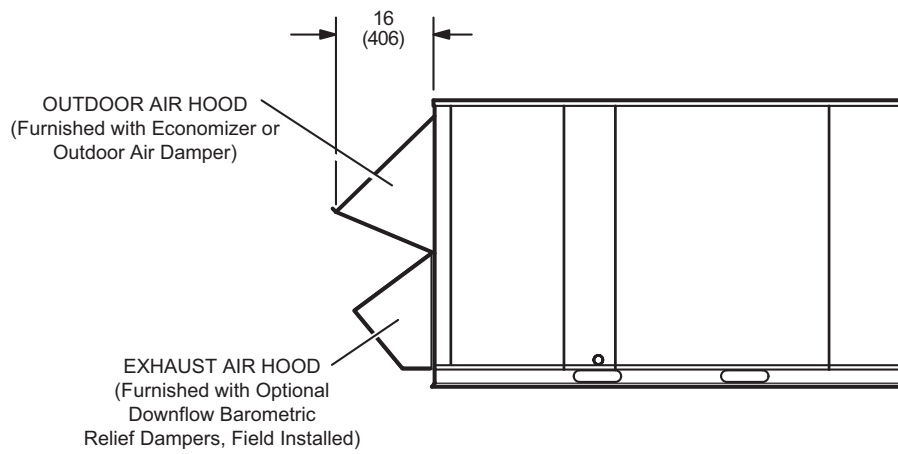


**OPTIONAL HORIZONTAL BAROMETRIC RELIEF DAMPERS WITH HOOD**  
(Field installed in horizontal return air duct adjacent to unit)

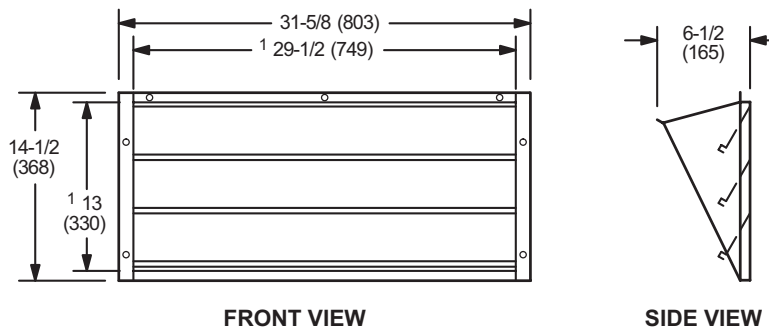


NOTE - Two furnished per order no.  
<sup>1</sup> NOTE - Opening size required in return air duct.

# DIMENSIONS - ACCESSORIES - INCHES (MM)


## HYBRID ROOF CURBS - DOUBLE DUCT OPENING

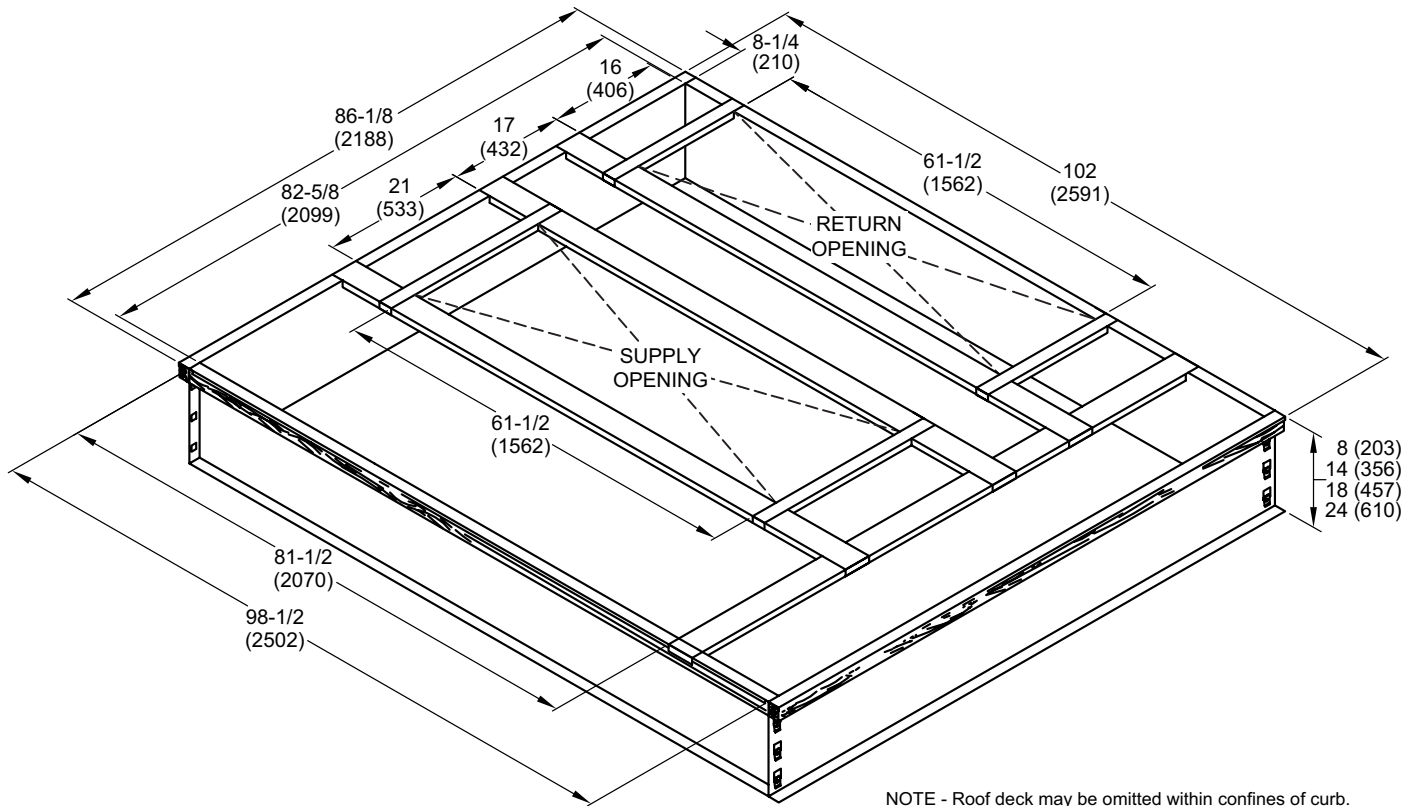

### TYPICAL FLASHING DETAIL FOR ROOF CURB

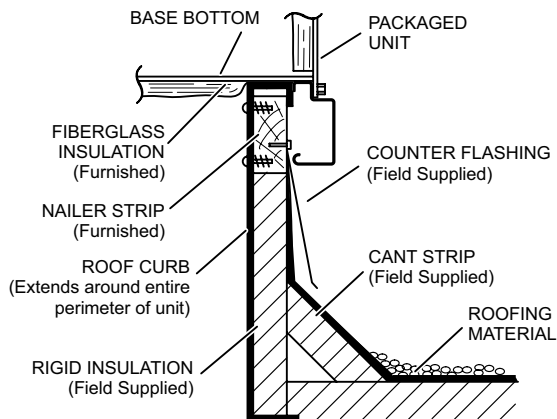


### DETAIL ROOF CURB

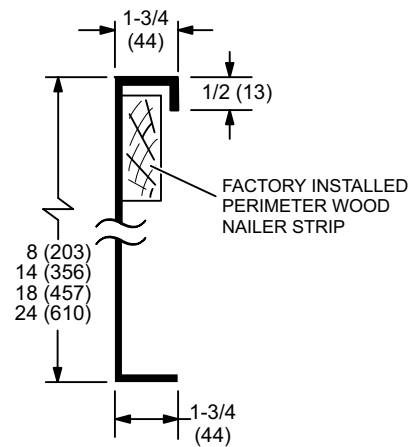


## DIMENSIONS - ACCESSORIES - INCHES (MM)

### ADJUSTABLE PITCH CURB - DOUBLE DUCT OPENING

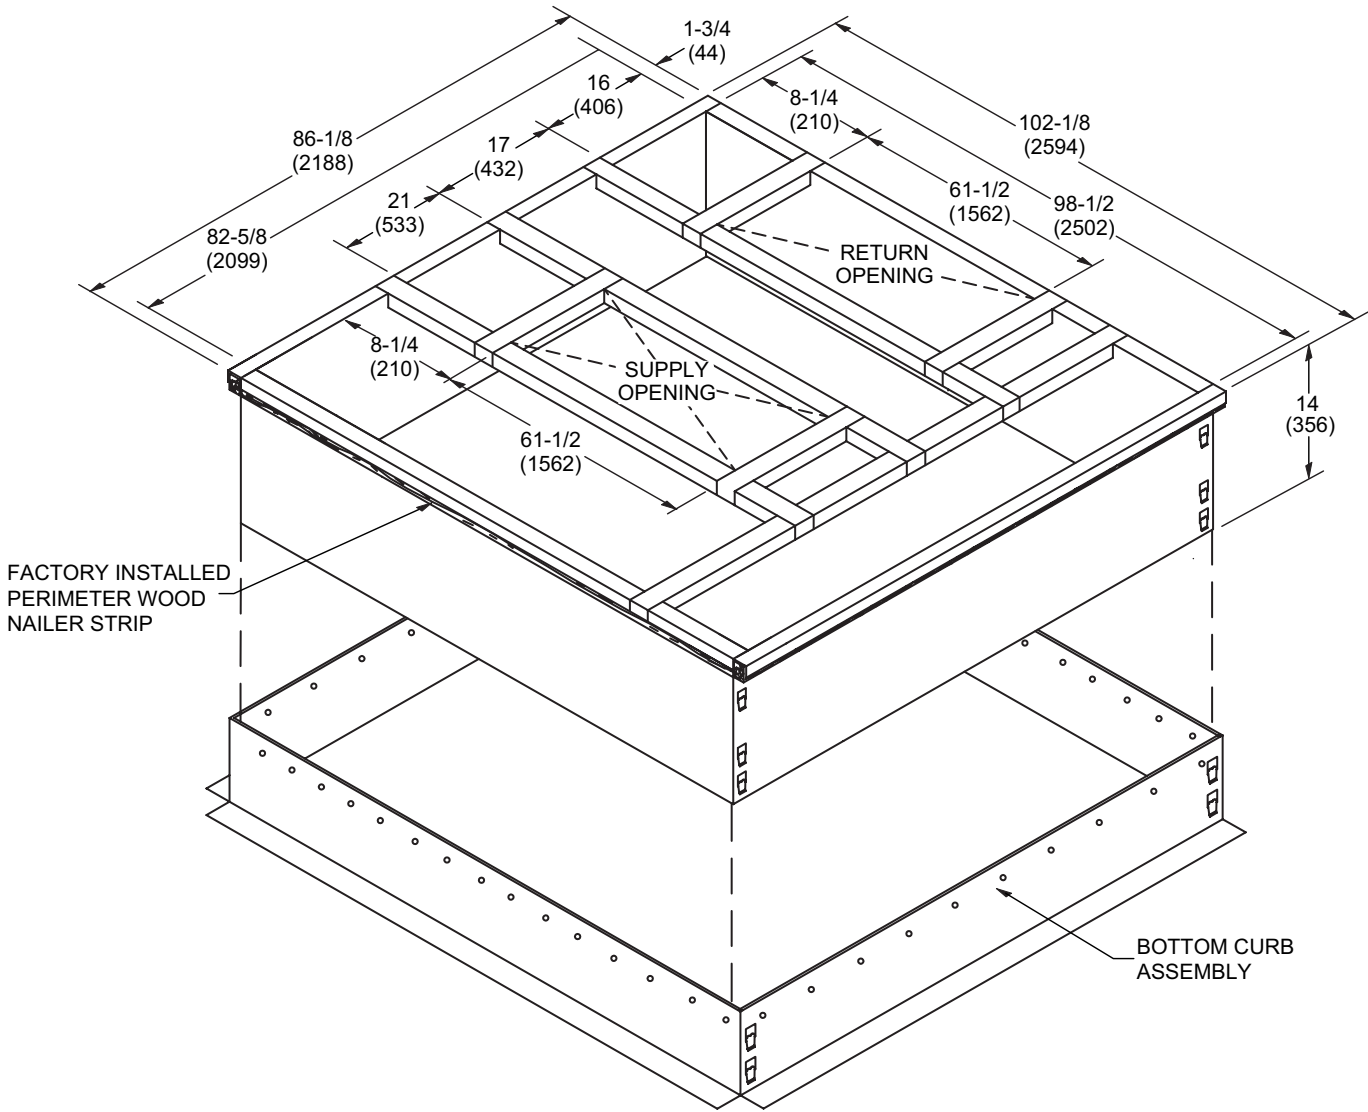


NOTE - Maximum slope pitch is 3/4 in. per 1 foot (19 mm per 305 mm) in any one direction.

#### TYPICAL FLASHING DETAIL FOR ROOF CURB

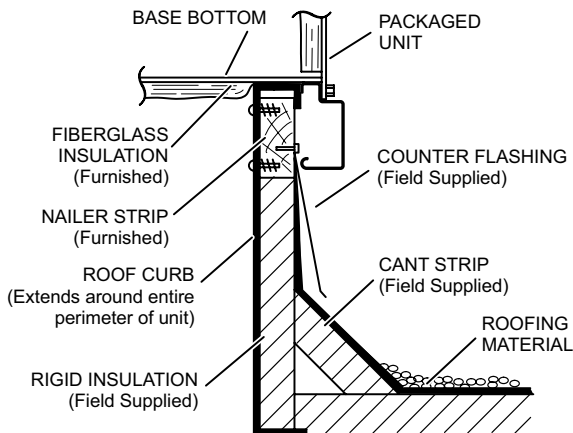


#### DETAIL ROOF CURB

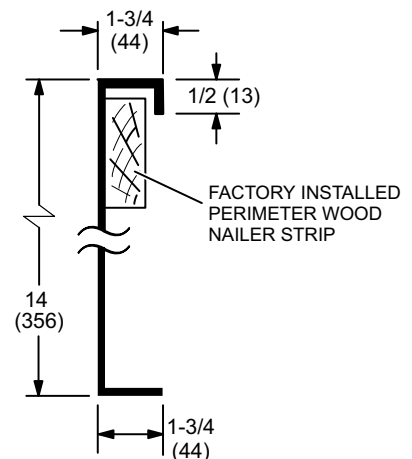




**DIMENSIONS - ACCESSORIES - INCHES (MM)**

**ROOF CURBS WITH SUPPLY & RETURN AIR TRANSITIONS FOR CEILING DIFFUSERS**

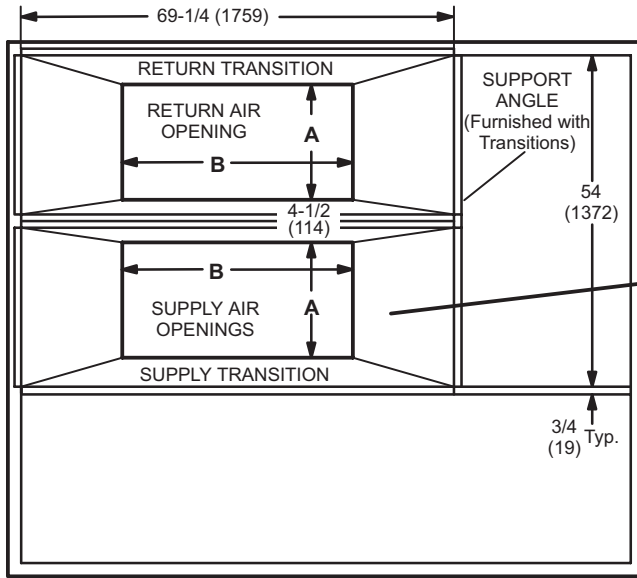

**TOP VIEW**

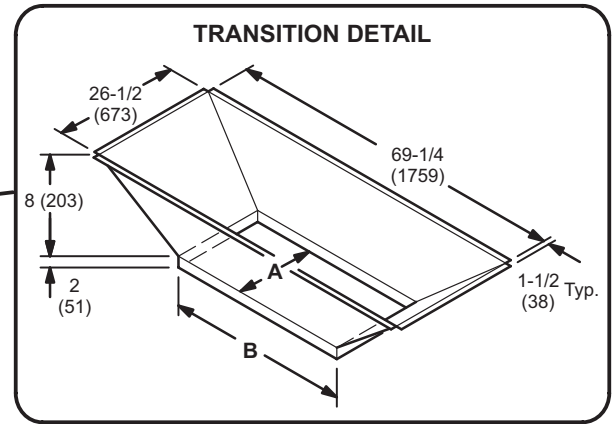


**TRANSITION OPENING SIZES**


Model Number	A		B	
	inch	mm	inch	mm
C1DIFF33C-1	18	457	36	914
C1DIFF34C-1	24	610	48	1219

# DIMENSIONS - ACCESSORIES - INCHES (MM)

## HORIZONTAL ROOF CURBS – Requires Optional Horizontal Return Air Panel Kit

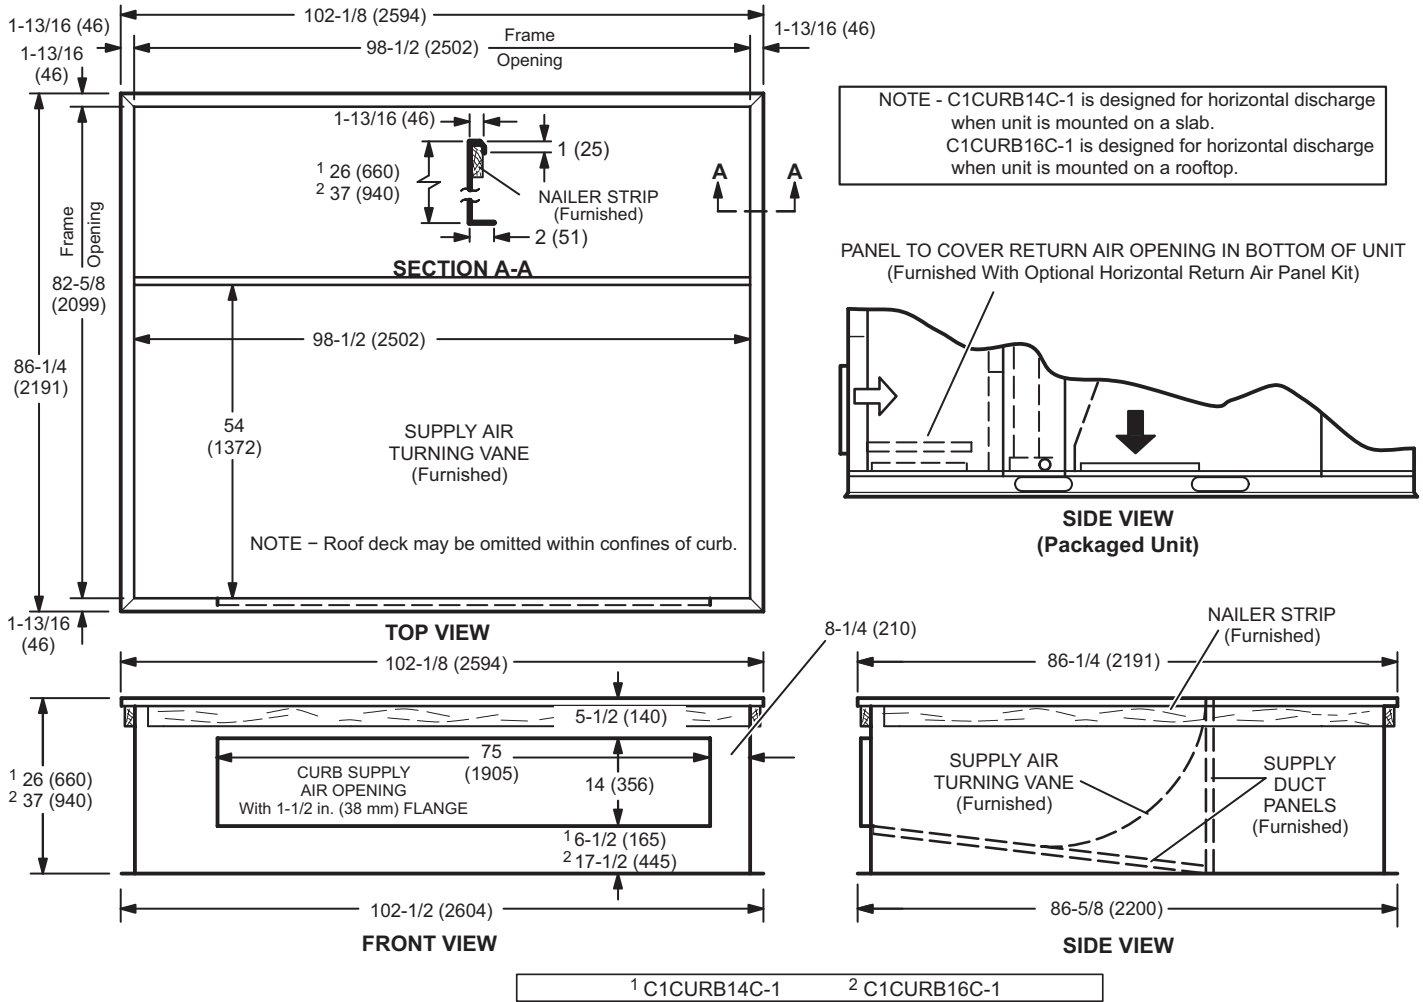


## HORIZONTAL SUPPLY AND RETURN AIR OPENINGS WITH HORIZONTAL ROOF CURB

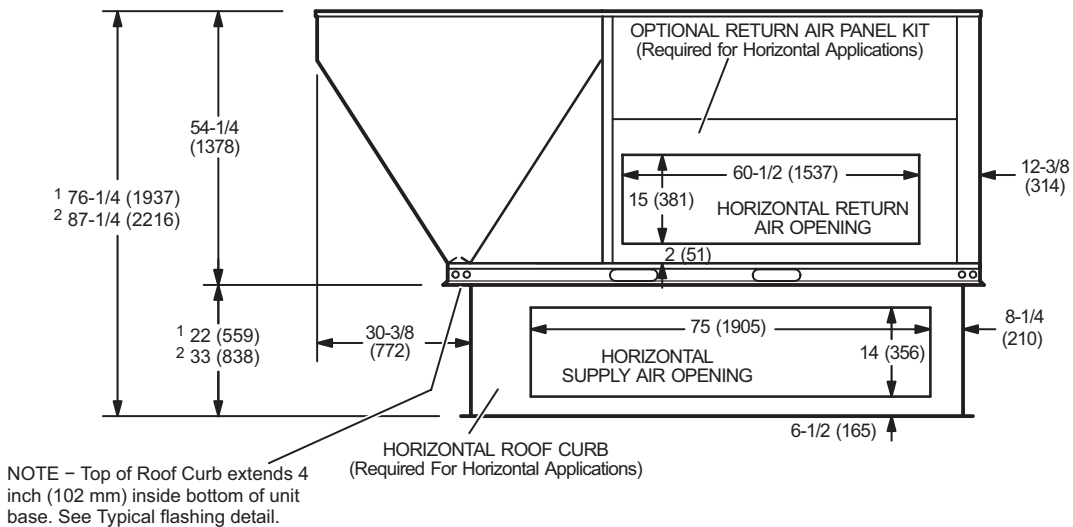


## DIMENSIONS - ACCESSORIES - INCHES (MM)

### COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS

#### STEP-DOWN CEILING DIFFUSER

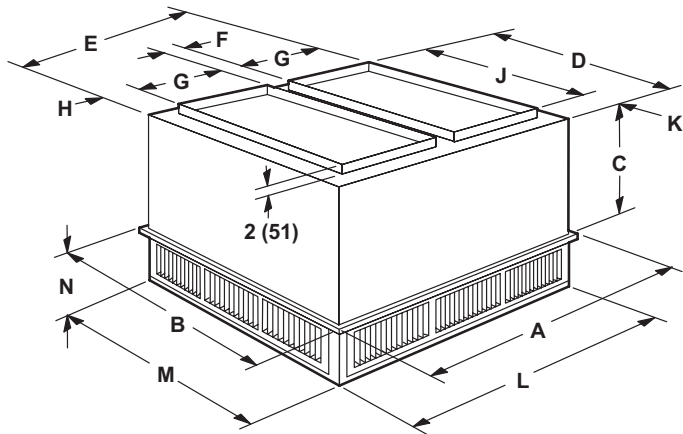

#### FLUSH CEILING DIFFUSER

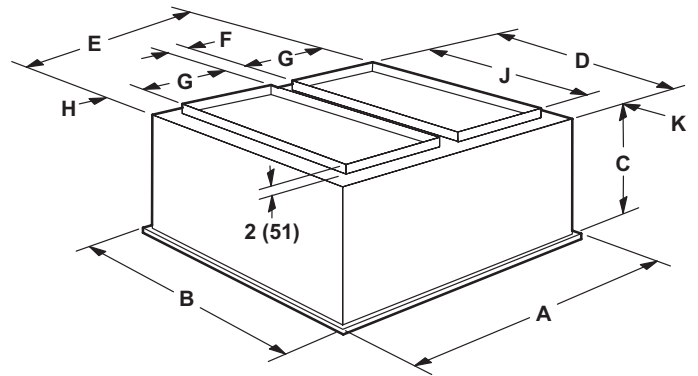

Model Number		RTD11-185S	RTD11-275
A	in.	47-5/8	59-5/8
	mm	1210	1514
B	in.	47-5/8	59-5/8
	mm	1210	1514
C	in.	24-5/8	30-5/8
	mm	625	778
D	in.	45-1/2	57-1/2
	mm	1156	1461
E	in.	45-1/2	57-1/2
	mm	1156	1461
F	in.	4-1/2	4-1/2
	mm	114	114
G	in.	18	24
	mm	457	610
H	in.	2-1/2	2-1/2
	mm	64	64
J	in.	36	48
	mm	914	1219
K	in.	4-3/4	4-3/4
	mm	121	121
L	in.	45-1/2	57-1/2
	mm	1156	1461
M	in.	45-1/2	57-1/2
	mm	1156	1461
N	in.	10-1/8	11-1/8
	mm	257	283
Duct Size	in.	18 x 36	24 x 48
	mm	457 x 914	610 x 1219

Model Number		FD11-185S	FD11-275
A	in.	47-5/8	59-5/8
	mm	1210	1514
B	in.	47-5/8	59-5/8
	mm	1210	1514
C	in.	29-1/4	35-1/4
	mm	743	895
D	in.	45	57
	mm	1143	1148
E	in.	45	57
	mm	1143	1448
F	in.	4-1/2	4-1/2
	mm	114	114
G	in.	18	24
	mm	457	610
H	in.	2-1/4	2-1/4
	mm	57	57
J	in.	36	48
	mm	914	1219
K	in.	4-1/2	4-1/2
	mm	114	114
Duct Size	in.	18 x 36	24 x 48
	mm	457 x 914	610 x 1219

## REVISIONS

Section	Description
Optional Accessories	Added Air Movement and Control Association International (AMCA) Class 1A certification for High Performance Economizers.



Visit us at [www.lennox.com](http://www.lennox.com)

For the latest technical information, [www.lennoxcommercial.com](http://www.lennoxcommercial.com)

Contact us at 1-800-4-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2017 Lennox Industries, Inc.