

Job Name/Location:

Tag #:

Date:

For: File Resubmit

PO No.:

Approval Other _____

Architect:

GC:


Engr:

Mech:

Rep:

(Company)

(Project Manager)

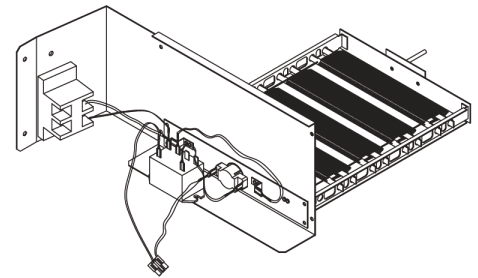

Multi V™ Electric Heater Accessory

For use with Vertical Air Handling Units



Electrical:

Power Requirements	208-230 Volt, 1 Phase, Separate power supply required
Control Requirements	Wiring harness plugs into vertical air handler control board terminal

Electric Heater Static Pressure Drop Factors		
Heater Model	Heater Capacity (kW)	Static Pressure Drop (in.wc)
ANEH053B1	5	-0.01
ANEH103B2	10	-0.02
ANEH153B2	15	-0.04
ANEH203B2	20	-0.06

Minimum Airflow by Heater Capacity (CFM)				
Vertical Air Handler	Heater Capacity			
	5 kW	10 kW	15 kW	20 kW
ARNU123NJA2	380	Not Available	Not Available	Not Available
ARNU183NJA2	380	Not Available	Not Available	Not Available
ARNU243NJA2	480	480	Not Available	Not Available
ARNU303NJA2	630	630	Not Available	Not Available
ARNU363NJA2	780	780	780	780
ARNU423NKA2	1000	1000	1000	1000
ARNU483NKA2	1000	1000	1000	1000
ARNU543NKA2	1300	1300	1300	1300

Electrical Data			
Heater Model	Capacity (kW)	Minimum Wire Size (AWG)	Maximum Fuse Size (Amps)
ANEH053B1	5	10	30
ANEH103B2	10	6	60
ANEH153B2	15	4	90
ANEH203B2	20	2	110

Notes:

Follow all installation instructions in the Vertical Air Handler Installation manual.

Job Name/Location:

Multi V™ Electric Heater Accessory

For use with Vertical Air Handling Units



Tag #:

Date:

PO No.:

