

Job Name/Location:

Tag No.:

Date:

For:	File	Resubmit
	Approval	Other_____

PO No.:

Architect: GC:

Engr: Mech:

Rep: (Company) (Project Manager)

LC489HHV

Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED®

Outdoor Unit (ODU) - LUU480HHV, Indoor Unit (IDU) - LCN489HV

Performance:**Cooling:**

Cooling Capacity (Min~Rated~Max, Btu/h)	19,200~ 48,000~53,000
SEER2	17.50
EER2	12.50

SEER - Seasonal Energy Efficiency Ratio

EER - Energy Efficiency Ratio

Heating:

Heating Capacity (Min~Rated~Max, Btu/h)	19,000~52,000~61,000
HSPF2	10.65
Max. Heating @ Indoor 70°F DB (Btu/h)	54,500
Outdoor 17°F WB	40,500
Outdoor 5°F WB	43,740
Outdoor -4°F WB	35,980

HSPF - Heating Seasonal Performance Factor

Heating Nominal Test Conditions:

Cooling Nominal Test Conditions:

Indoor: 70°F DB / 60°F WB

Indoor: 80°F DB / 67°F WB

Outdoor: 47°F DB / 43°F WB

Outdoor: 95°F DB / 75°F WB

Electrical:

Power Supply (V~/Hz/Ø)	208-230/60/1
MOP (A)	40
MCA (A)	32
Cooling / Heating Rated Amps (A)	17.0 / 17.1
Compressor (A)	22
Fan Motor (IDU + ODU) (A)	1.3 + (1.6 x 2)
Cooling Power Input (Min~Rated~Max, kW)	1.09~3.84~5.82
Heating Power Input (Min~Rated~Max, kW)	1.40~3.85~6.20
Locked Rotor Amps (A)	33

MOP - Maximum Overcurrent Protection

MCA - Minimum Circuit Ampacity

Piping:

Installed Liquid Pipe (in., O.D.)	3/8 Flare
Installed Vapor Pipe (in., O.D.)	5/8 Flare
IDU Liquid Connection (in., O.D.)	3/8 Flare
IDU Vapor Connection (in., O.D.)	5/8 Flare
Additional Refrigerant (oz./ft.)	0.43
Min. / Max. Pipe Length (ft.) ²	16.4 / 246
Piping Length (no add'l refig., ft.)	24.9
Max. Elevation (ft.)	98.4

Features:

- Inverter (Variable Speed Compressor)
- Auto Restart
- Auto Changeover
- Internal Condensate Pump
- Ultra-quiet Turbo Fan
- Night Quiet Function
- Jet Cool / Jet Heat
- Optional Wi-Fi Control
- Drain Pan Heater
- Swirl Wind
- Direct / Indirect Wind
- Smart Mode
- Refresh Mode

Included Accessories:

- Wireless Remote Controller - AKB75735404

Required Accessories:

- ☐ Grille Kit - PT-AAGW0

Optional Accessories:

- ☐ Premium Controller - PREMTA000
- ☐ MultiSITE™ CRC1 - PREMTBVC0
- ☐ MultiSITE CRC1+ - PREMTBVC1
- ☐ MultiSITE Comm. Mgr. - PBACNBTR0A
- ☐ PI-485 - PMNFP14A1
- ☐ Dry Contact - PDRYCB320
- ☐ LonWorks® Gateway - PLNWKB100
- ☐ AC Smart 5 BACnet® Gateway - PACS5A000
- ☐ ACP 5 BACnet Gateway - PACP5A000
- ☐ Outside Air Flange - PTVK430
- ☐ Wi-Fi Module - PWFMD200
- ☐ Low Ambient Wind Baffle (Cooling operation to -4°F) - ZLABGP04A¹⁰

**Operating Range:****Outdoor Unit:**

Cooling (°F DB)	5 ~ 118
Heating (°F WB)	-13 ~ +64

Indoor Unit:

Cooling (°F WB)	57 ~ 77
Heating (°F DB)	59 ~ 81

System Data:

Refrigerant Type	R410A
Refrigerant Control	EEV
Refrigerant Charge (lbs.)	9.26
ODU Sound Pressure (Cooling / Heating) (±1 dB[A]) ³	54 / 56
IDU Sound Pressure (H/M/L/SL) (±1 dB[A]) ³	46 / 43 / 41 / 39
ODU Net / Shipping Weight (lbs.)	210.9 / 234.1
IDU Net / Shipping Weight (lbs.)	59.5 / 70.5
Grille Net Weight (lbs.)	15.6
Heat Exchanger Coating	GoldFin™

Fan:

ODU Type	Propeller
IDU Type	Turbo
Fan Speeds (Fan/Cool/Heat)	4 / 5 / 5
Quantity (ODU + IDU)	2 + 1
Motor/Drive	Brushless Digitally Controlled/Direct
Maximum ODU Air Volume (CFM)	4,238
IDU Air Flow (CFM Max./H/M/L)	1,483 / 1,130 / 953 / 812
Dehumidification (pts./hr.)	9.74

Notes:

1. Acceptable operating voltage: 187V-253V.
2. Piping lengths are equivalent.
3. Sound Pressure levels are tested in an anechoic chamber under ISO Standard 3745.
4. All communication / connection (power) cable from the outdoor unit to the indoor unit is field supplied and must be a minimum of four-conductor, 14 AWG, stranded, shielded or unshielded (if shielded, it must be grounded to the chassis of the outdoor unit only), and must comply with applicable local and national codes.
5. See Engineering Manual for sensible and latent capacities.
6. Power wiring cable size must comply with the applicable local and national code.
7. This unit comes with a dry helium charge.
8. This data is rated 0 ft. above sea level, with 24.6 ft. of refrigerant line and a 0 ft. level difference between outdoor and indoor units.
9. Must follow installation instructions in the applicable LG installation manual.
10. If the optional low ambient wind baffle (ZLABGP04A) is used, one wind baffle is required for each ODU fan.


BACnet® is a registered trademark of ASHRAE. LonWorks® is a trademark of Echelon Corporation.



LC489HHV
Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED®
Outdoor Unit (ODU) - LUU480HHV, Indoor Unit (IDU) - LCN489HV




Tag No.: _____
Date: _____
PO No.: _____

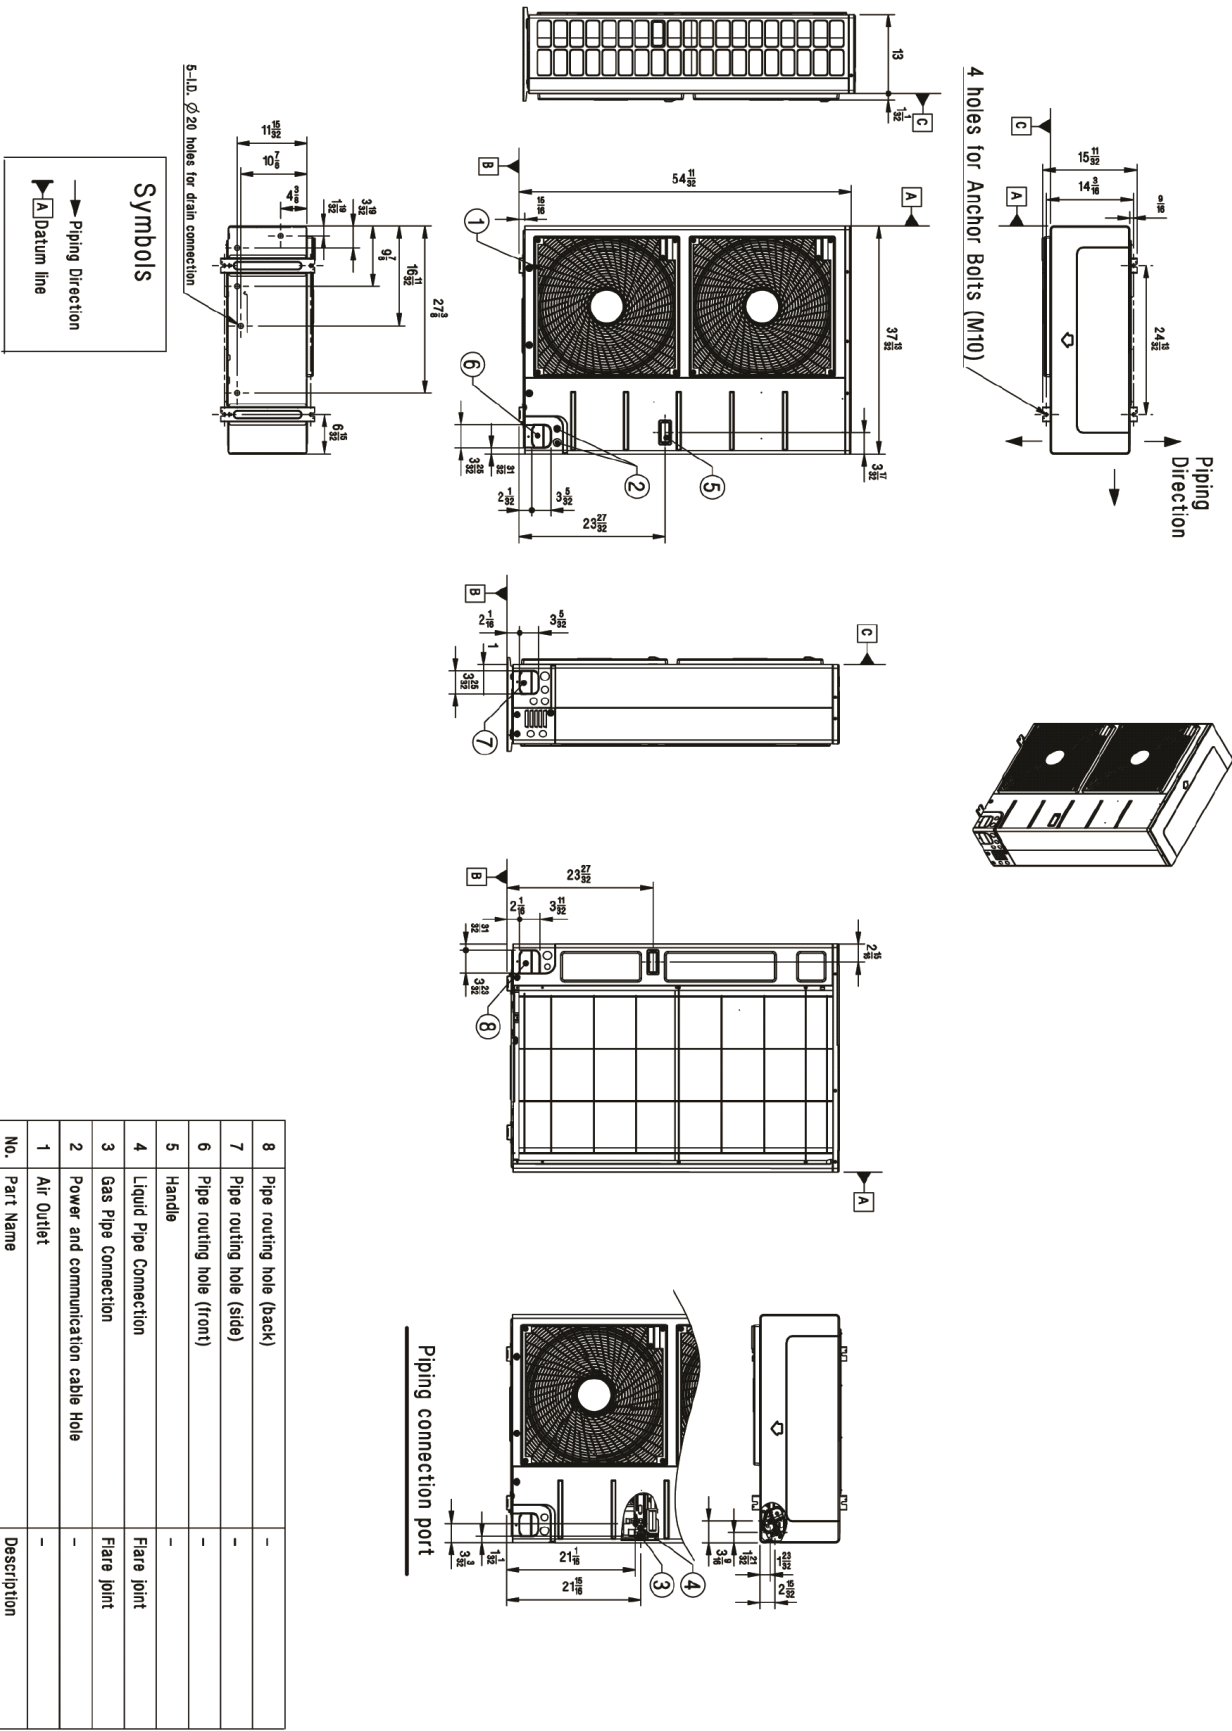

No.	Part Name	Description
1	Air Outlet	-
2	Power and communication cable Hole	-
3	Gas Pipe Connection	Flare joint
4	Liquid Pipe Connection	Flare joint
5	Handle	-
6	Pipe routing hole (front)	-
7	Pipe routing hole (side)	-
8	Pipe routing hole (back)	-

LC489HHV
Single-Zone 3x3 Four-Way Ceiling Cassette with LGRED°
Outdoor Unit (ODU) - LUU480HHV, Indoor Unit (IDU) - LCN489HV

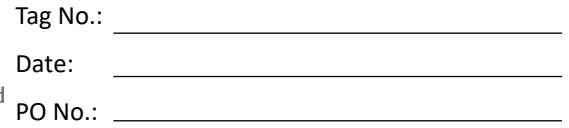

11	Fresh Air Intake Hole	Knock-out type
10	Flexible Drain Hose	Supplied with product
9	Decoration Corner Cover	Supplied with panel
8	Decoration Panel (Accessory)	PF*-WA*W
7	Air Outlet	-
6	Air Inlet	-
5	Wired remote controller wire routing hole	-
4	Power and communication cable routing hole	-
3	Drain Pipe Connection	-
2	Liquid Pipe Connection	-
1	Gas Pipe Connection	-
No.	Part Name	Description

(Keep this distance between the bottom surface of body and Ceiling Surface)