Job Name/Location:		7	Tag #:	
Date:	For: File	Resubmit		
PO No.:	Approval	Other	• C LG	
Architect: GC:				€ LG
	h·			
	11.			
Rep: (Company) (Project	Manager)			
LV420HHV Single Zone LGRED° Vertical Air Handler U Outdoor Unit (ODU) - LUU420HHV Indoor Unit (IDU) - LV		Life's Good		
Performance: Cooling:		Operating Range:		
Cooling Capacity (Min~Rated~Max, Btu/h) 16,800 ~ 4	2,000 ~ 50,000	Outdoor Unit: Cooling (°F DB)		5 to 118
SEER / EER	19.6 / 12.5	Heating (°F WB)		-13 to 64
Heating:		Indoor Unit:		
Heating Capacity (Min~Rated~Max, Btu/h) 18,000 ~ 4	8,000 ~ 60,000 11.0	Cooling (°F WB) Heating (°F DB)		57 to 77 59 to 81
Max heating @ Indoor 70° DB (Btu/h)	F2 200	System Data:		
Outdoor 17°F WB	52,200 48,000	Refrigerant Type/Co	ontrol	R410A / EEV
Outdoor 5°F WB Outdoor -4°F WB	38,200	Refrigerant Charge (		9.26
Outdoor -13°F WB	28,810		re Max (Cool / Heat) ±1 dB(A) <sup>3</sup>	54 / 56
HSPF - Heating Seasonal Performance Factor Cooling Nominal Test Conditions: Heating Nominal Test Condition	ons:	IDU Sound Pressure ODU Net / Shipping		48 / 45 / 44 210.9 / 234.1
Indoor: 80°F DB / 67°F WB         Indoor: 70°F DB / 60°F WB           Outdoor: 95°F DB / 75°F WB         Outdoor: 47°F DB / 43°F WB		IDU Net / Shipping \		158.7 / 176.4
Electrical:		Fan:		
	08-230 / 60 / 1	ODU / IDU Fan Type	e	Propeller / Sirocco
MOP / MCA (A) Cooling / Heating Rated Amps (A)	40 / 32 14.9 / 16.4	Fan Speeds (Fan/Co		3/3/3
Compressor(A)	22.0	Fan Quantity (ODU		2 + 1
Fan Motor (IDU + ODU) (A)	1.3 + (1.6 x 2)	Motor/Drive	Brushless Digitall	y Controlled / Direct
Cooling Power Input (Min~Rated~Max, kW) 1.1	9 ~ 3.36 ~ 5.32	Maximum ODU Air	Volume (CFM)	4,238
Heating Power Input (Min~Rated~Max, kW) 1	.34 ~ 3.69 ~ 5.8	IDU Air Volume (H/M/L) (CFM) 1,260 / 1,100 / 1,00		1,260 / 1,100 / 1,000
Locked Rotor Amps (A)	33	Dehumidification R	.,	6.76
MOP - Maximum Overcurrent Protection MCA - Minimum Circuit Ampa	city	IDU External Static		0.1~ 0.3 ~ 1.0
Piping: Installed Liquid Pipe (in., O.D.)	3/8 Flare	Range (Min~Defaul	Talviax) (in-mg)	0.1~ 0.3 ~ 1.0
Installed Vapor Pipe (in., O.D.)	5/8 Flare	Notes:		
IDU Liquid Connection (in., O.D.)	3/8 Flare	Acceptable operating vo     Piping lengths are equiva	alent.	ICO Standard 2745
IDU Vapor Connection (in., O.D.)	5/8 Flare	4. All power/communication	on cable to be minimum 14 American wi	ire gage (AWG), 4-
Additional Refrigerant (oz./ft.)	0.43	national code. If shielded, to 5. Power wiring cable size in	re tested in an anechoic chamber under on cable to be minimum 14 American wi ded or unshielded wire and must comply the wire must be grounded to the chass must comply with the applicable local ar with a dry helium charge. Dove sea level, with 25 ft. of refrigerant li-	is at the outdoor unit only. nd national code.
Min/Max. Pipe Length (ft.)	16.4 / 246 24.9	<ol> <li>The indoor unit comes w</li> <li>This data is rated 0 ft. ab</li> </ol>	vith a dry helium charge. Dove sea level, with 25 ft. of refrigerant l	ine and a 0 ft. level
Piping Length (no add'l refrig., ft.)  Max. Elevation (ft.)	98.4	amerence between outdoo	or and indoor units. instructions in the applicable LG installa ient wind baffle (ZLABGP04A) is used, on	
	70.4	each ODII fan		
<ul> <li>Inverter (variable speed)</li> <li>Auto restart</li> <li>Timer (on/off)</li> <li>Sleep Mode</li> <li>IDU con</li> </ul>	ain Pan Heater uiet Function npatible with 8k, 24k, 36k	<ol><li>13. Electric heater accesso</li></ol>	is based on high speed airflow. units have ECM fan that automatically at ange. Therefore, there is no default ESP e supplied with socket adapters for pipe ory available in 3kW, 5kW, 8kW, 10kW, ngineering manual for details. id.	djusts throughout the ESP value for these units. transitions. 15kW, and 20kW
Required Accessories (sold separately): Controller (Any LG wired remote controller)				
Optional Accessories:  ☐ MultiSITE™ CRC1 - PREMTBVC0 ☐ MultiSITE CRC1+ - PREMTBVC1 ☐ MultiSITE Comm. Mgr PBACNBTR0A ☐ AC Smart 5 - PACSA000 ☐ ACP 5 - PACP5A000 ☐ Simple Controller - PREMTC00U ☐ Downflow Conversion ☐ Downflow Conversion ☐ Downflow Conversion	3320 affle (cooling LABGP04A <sup>9</sup> - ANEH033B1 <sup>13</sup>	LODES		ALD CERTIFIED®









Wi-Fi module - PWFMDD200 Remote Temperature Sensor - ZRTBS01 ☐ Downflow Conversion Kit - PNDFK0

for

Job Name/Location:


## LVN420HV Single Zone LGRED° Vertical Air Handler Unit




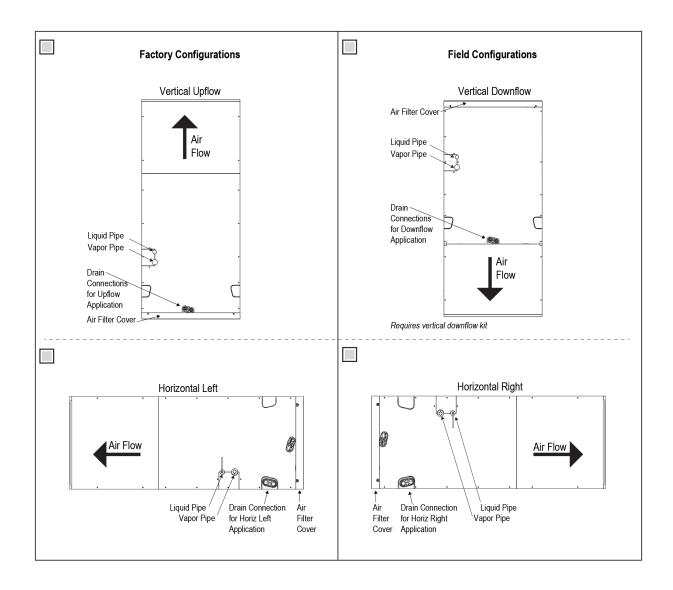


## LUU420HHV Single Zone LGRED° Vertical Air Handler Unit







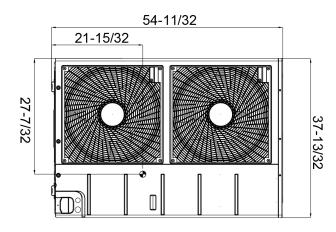









Unit: inch

Job Name/Location:

## LVN420HV Single Zone LGRED° Vertical Air Handler Unit



Tag No.: Date: Life's Good PO No.:

